


HVDC interconnection in Japan

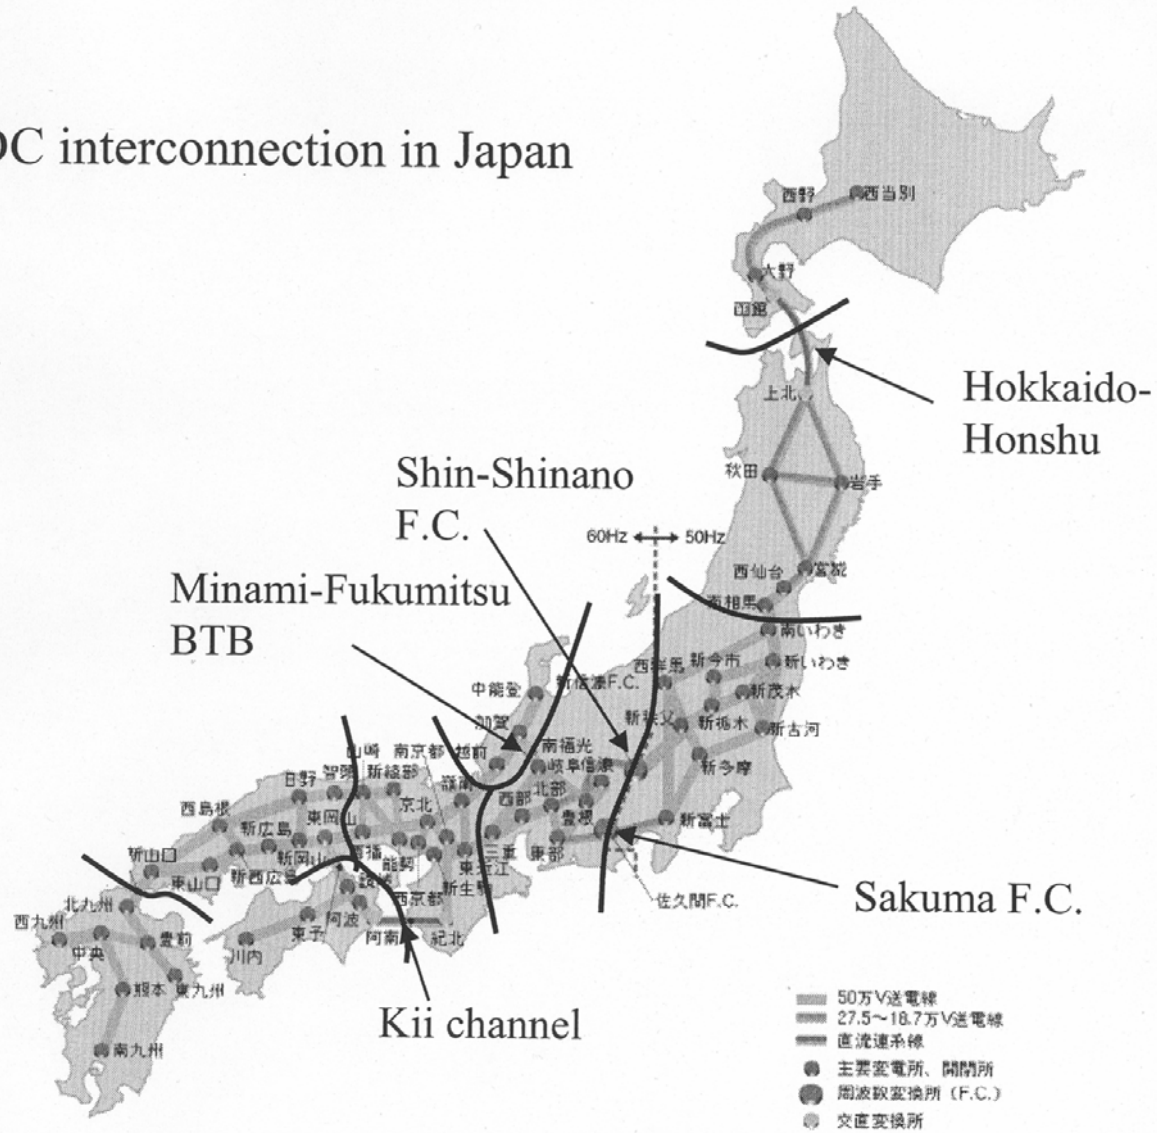

HVDC Projects in Japan

Project	Rated DC Voltage (kV)	Rated Capacity (MW)	Transmission distance [Cable] (km)	Year commissioned
Sakuma	125	300	0 (BTB)	1965
Shin Shinano	125	300	0 (BTB)	1977
	125	300	0 (BTB)	1992
Hokkaido-Honshu	125,250	300	168 [44]	1979,80
	± 250	600		1993
Minami Fukumitsu	125	300	0 (BTB)	1999
Kii Channel	± 250	1400	102 [51]	2000