

The SuperGrid:


Symbiosis of Nuclear, Hydrogen and Superconductivity



Paul M. Grant

EPRI Science Fellow (*retired*)
IBM Research Staff Member Emeritus
Principal, W2AGZ Technologies
w2agz@pacbell.net
www.w2agz.com

World Engineers' Conference
3-6 November 2004, Shanghai, PRC

Session FB (Energy and Power)
Paper FBR-003, Friday, 5 November 2004, 8:30 AM

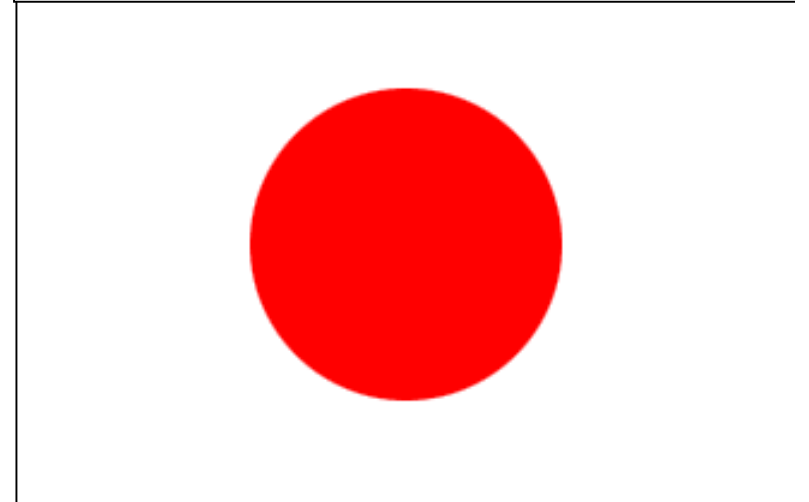

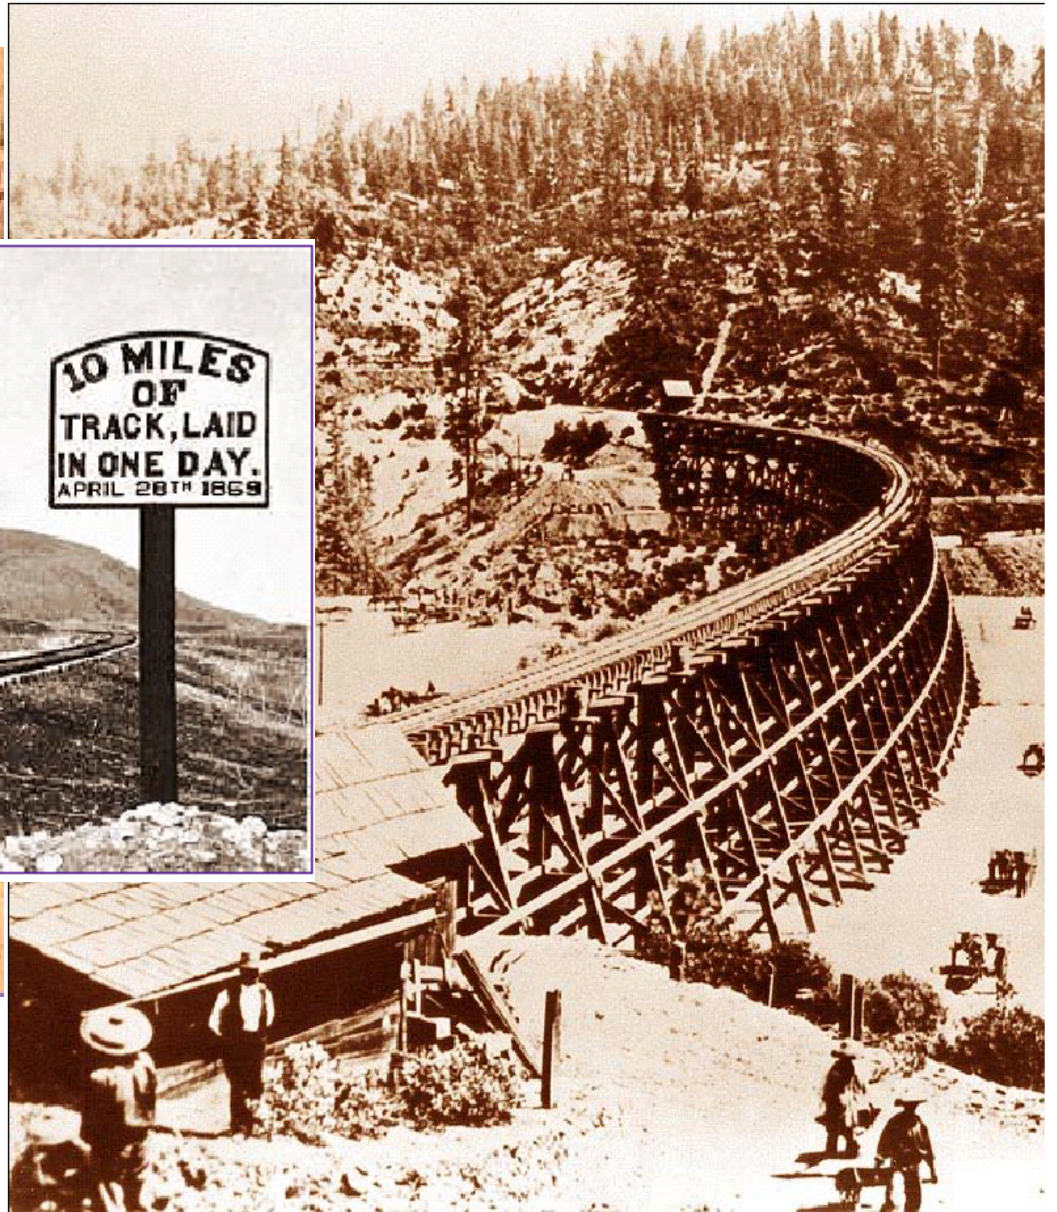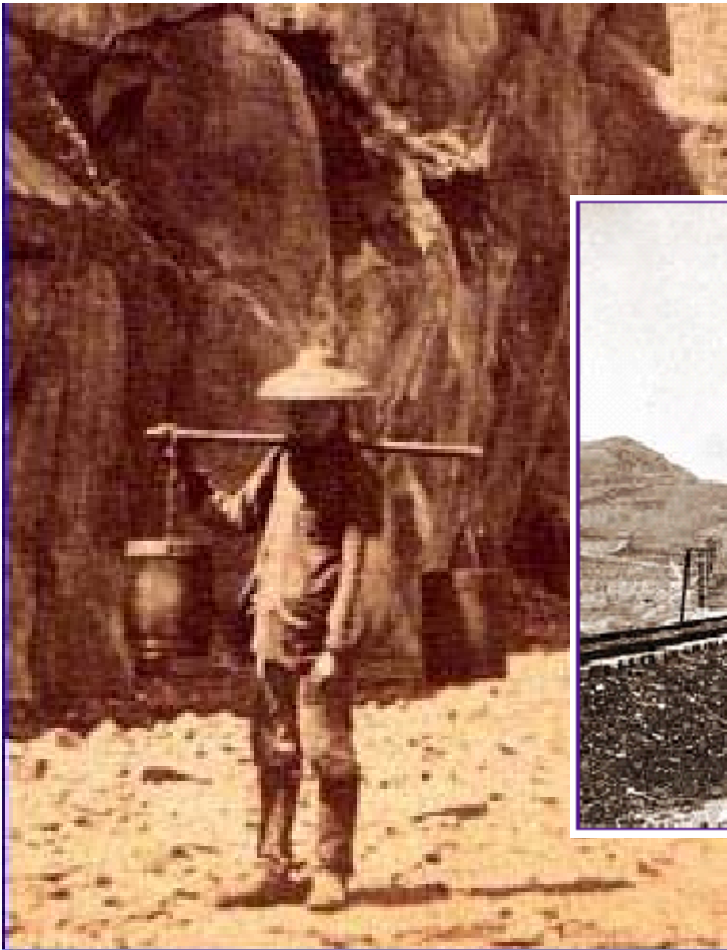




Xue Yuyang




Yao Ming

Earth at Night - 2000

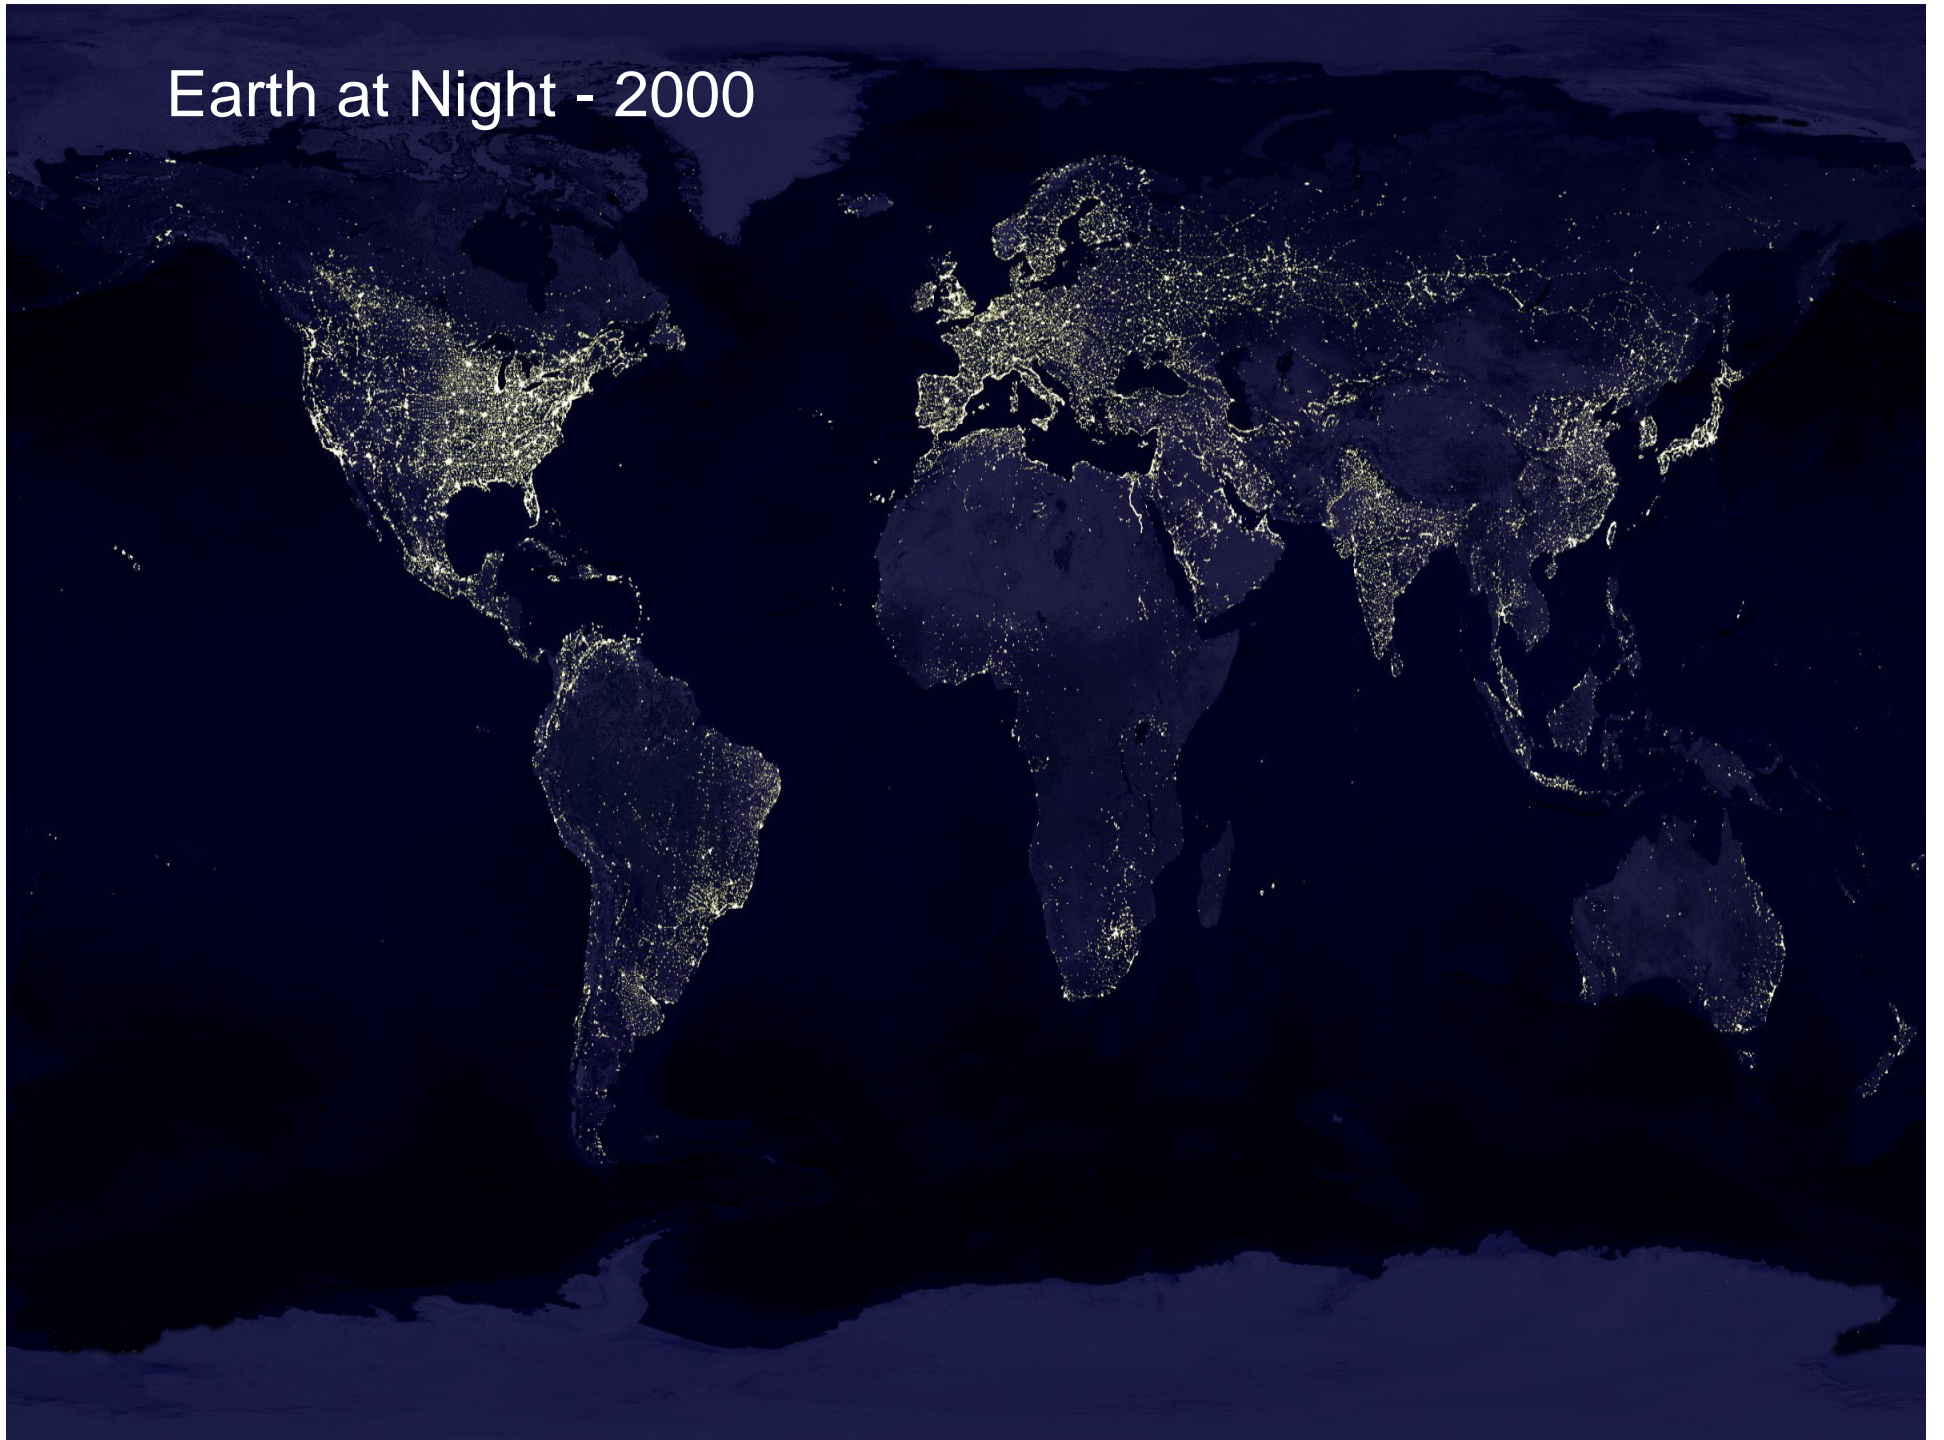

Earth at Night - 2050

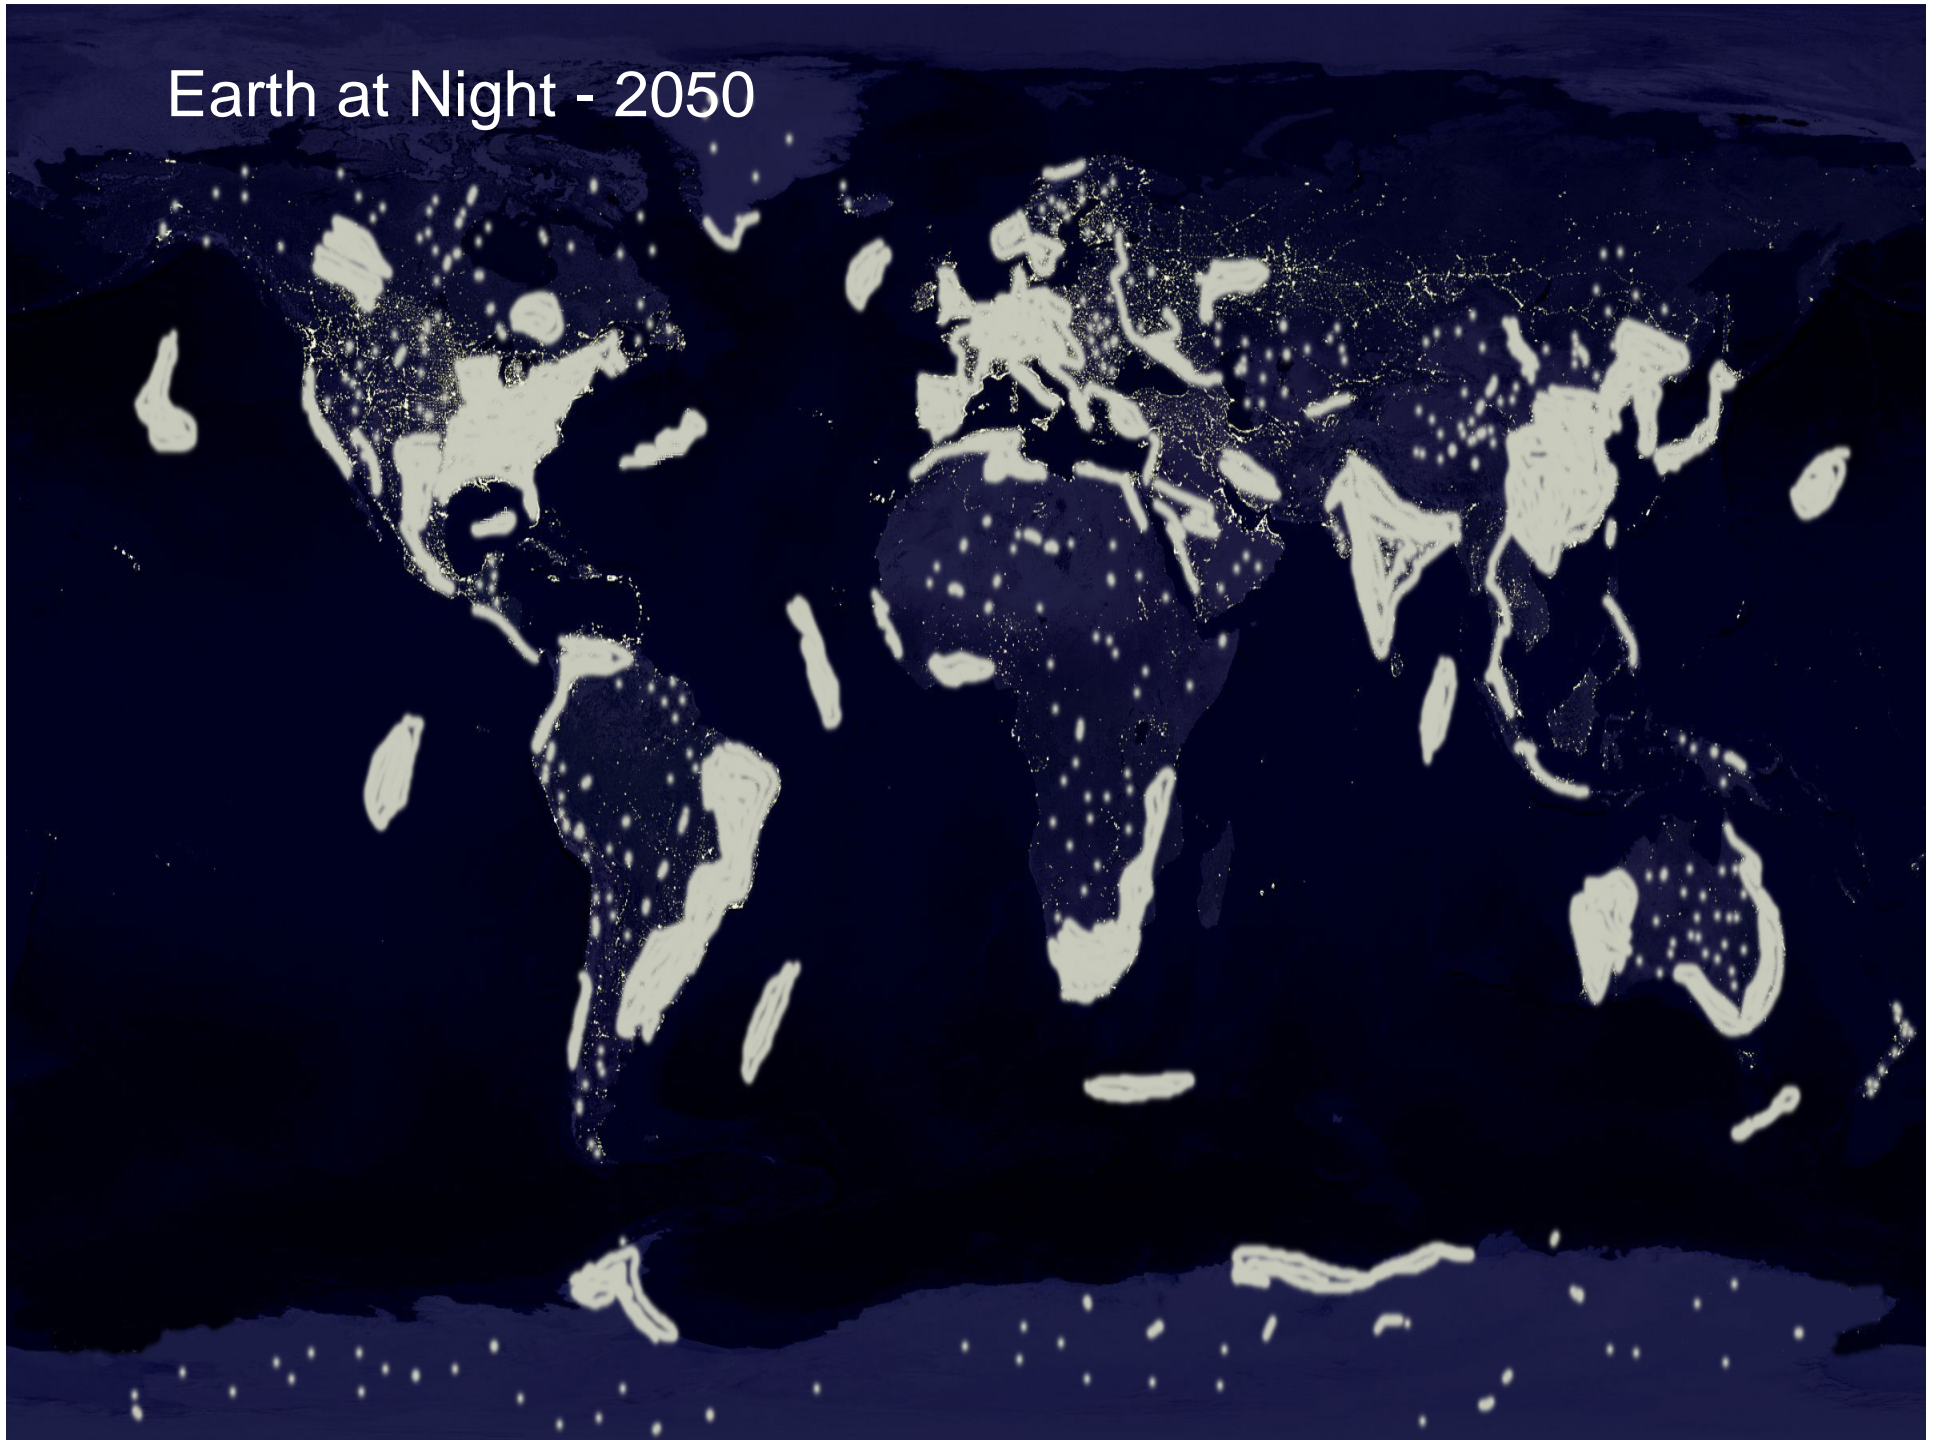

The 21st Century Energy Challenge

Design a communal energy economy to meet the needs of a densely populated industrialized world that reaches all corners of Planet Earth.

Accomplish this within the highest levels of environmental, esthetic, safe, reliable, efficient and secure engineering practice possible.

...without requiring any new scientific discoveries or breakthroughs!

Its Solution

A Symbiosis of

Nuclear/Hydrogen/Superconductivity

***Technologies supplying Carbon-free,
Non-Intrusive Energy for all Inhabitants
of Planet Earth***


Reading Assignment



1. [Garwin and Matisoo](#), 1967 (100 GW on Nb₃Sn)
2. [Bartlit, Edeskuty and Hammel](#), 1972 (LH₂, LNG and 1 GW on LTSC)
3. [Haney and Hammond](#), 1977 (Slush LH₂ and Nb₃Ge)
4. [Schoenung, Hassenzahl and Grant](#), 1997 (5 GW on HTSC, 1000 km)
5. [Grant](#), 2002 (SuperCity, Nukes+LH₂+HTSC)
6. [Proceedings](#), SuperGrid Workshop, 2002

These articles, and much more, can be found at www.w2agz.com, sub-pages [SuperGrid/Bibliography](#)


Past & Future Energy Supply

Fig. 1 Production Volume of Energy Resources

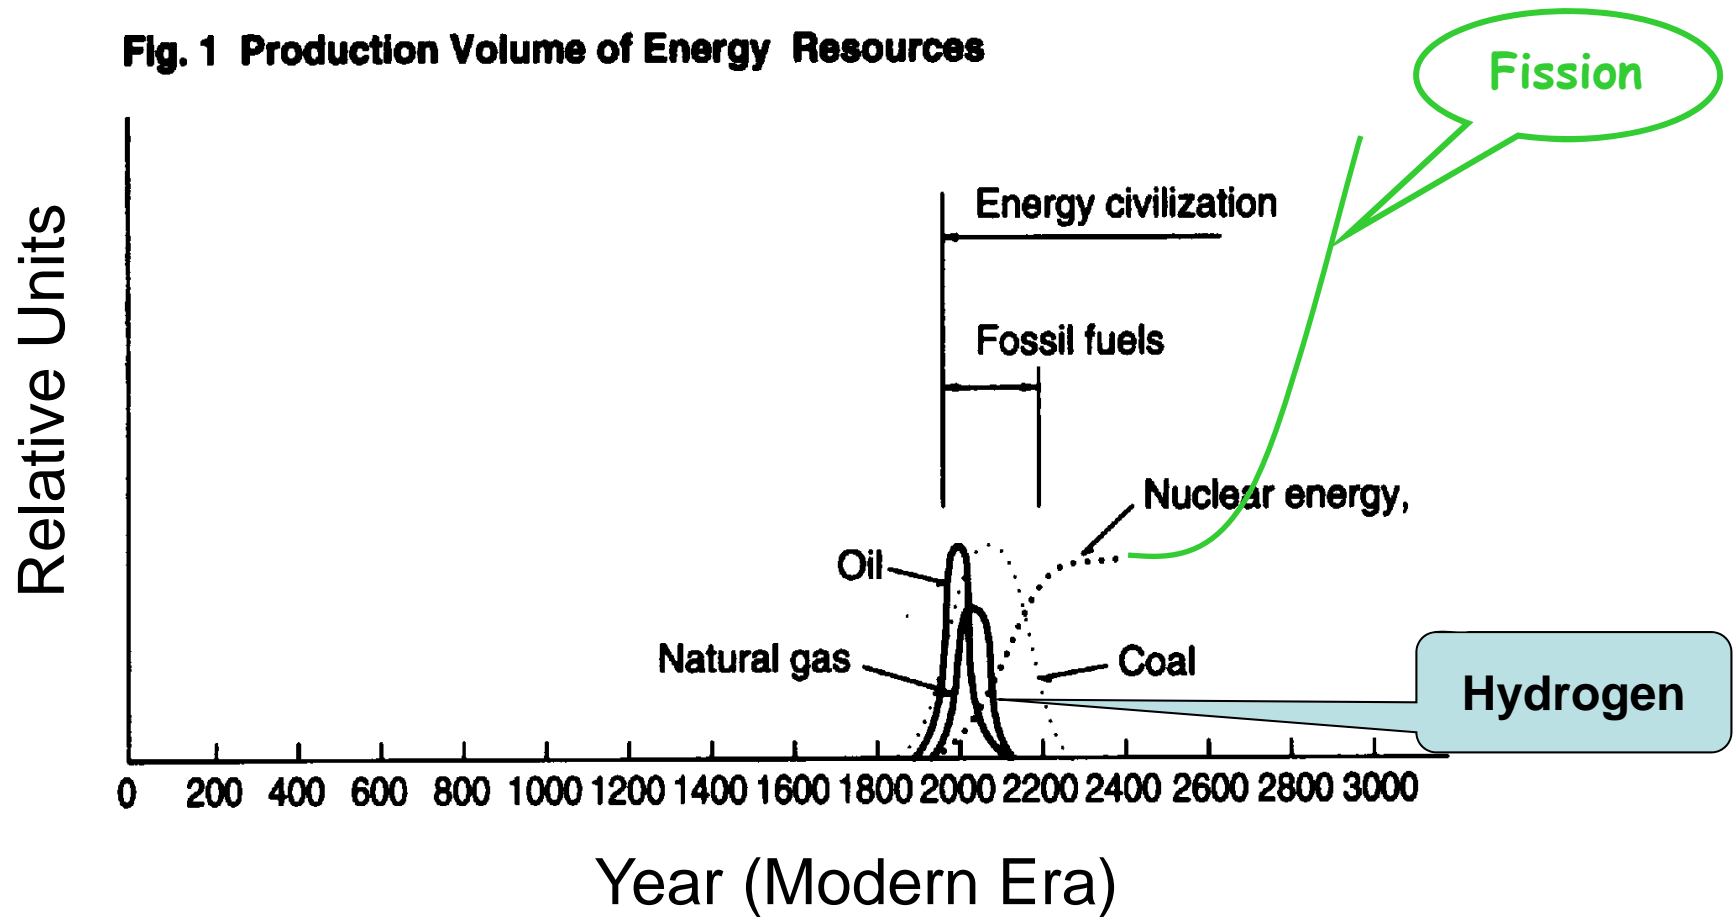

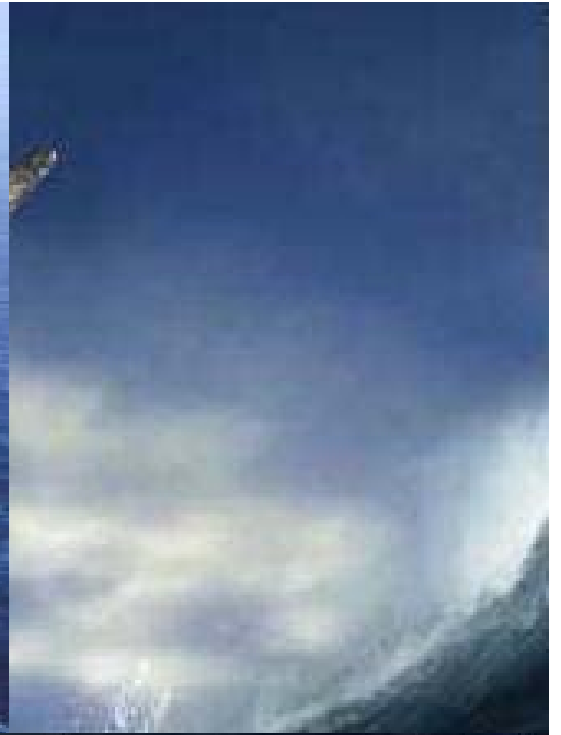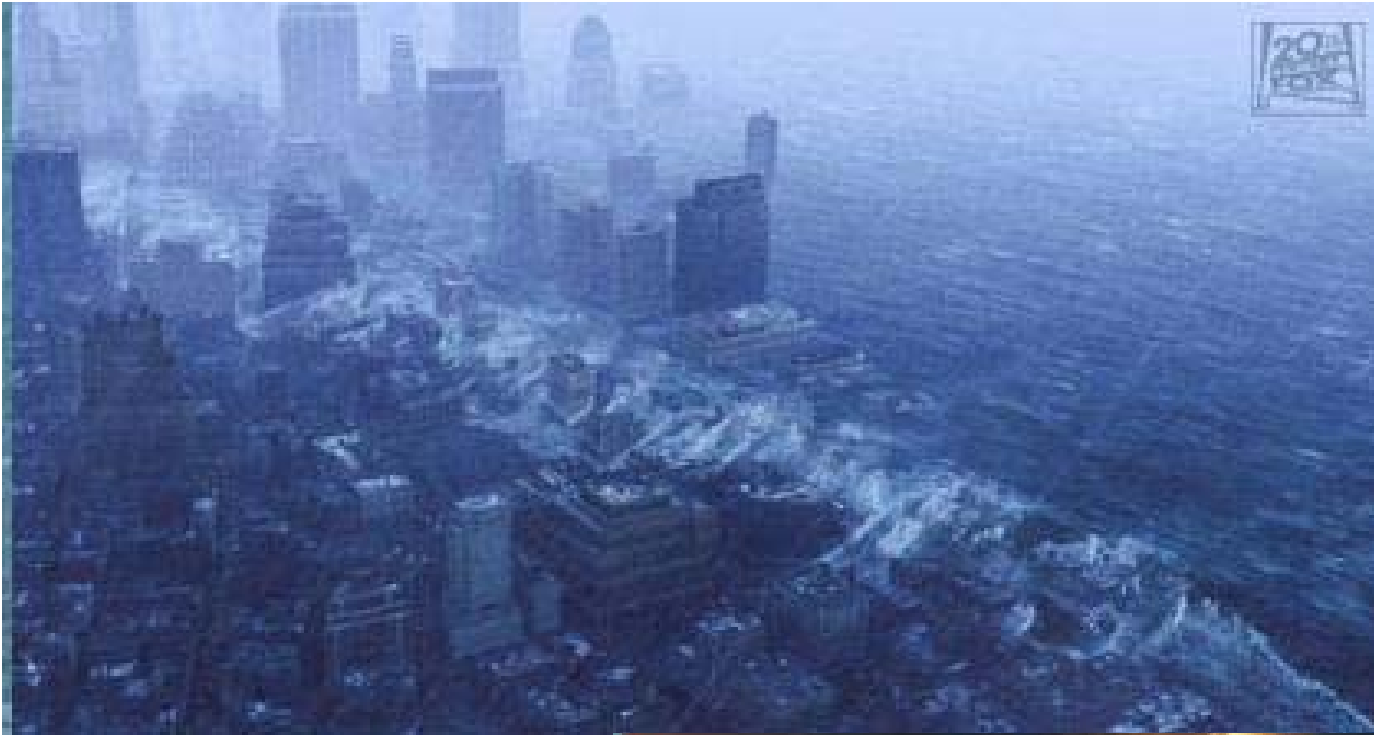


The Hydrogen Economy

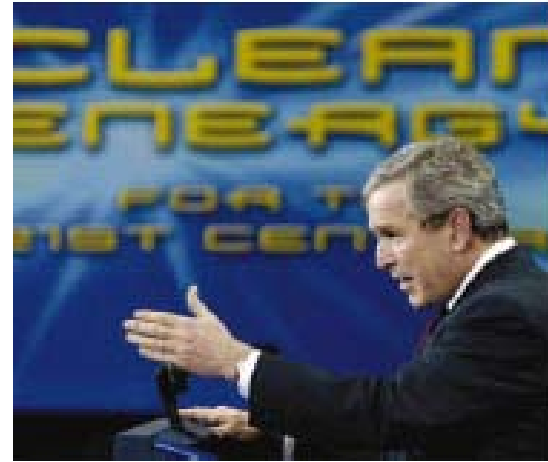

- You have to make it, just like electricity
- Electricity can make H₂, and H₂ can make electricity ($2\text{H}_2\text{O} \rightleftharpoons 2\text{H}_2 + \text{O}_2$)
- You have to make a lot of it
- You can make it cold, - 419 F (21 K)

P.M. Grant, "Hydrogen lifts off...with a heavy load," *Nature* 424, 129 (2003)

SuperCity

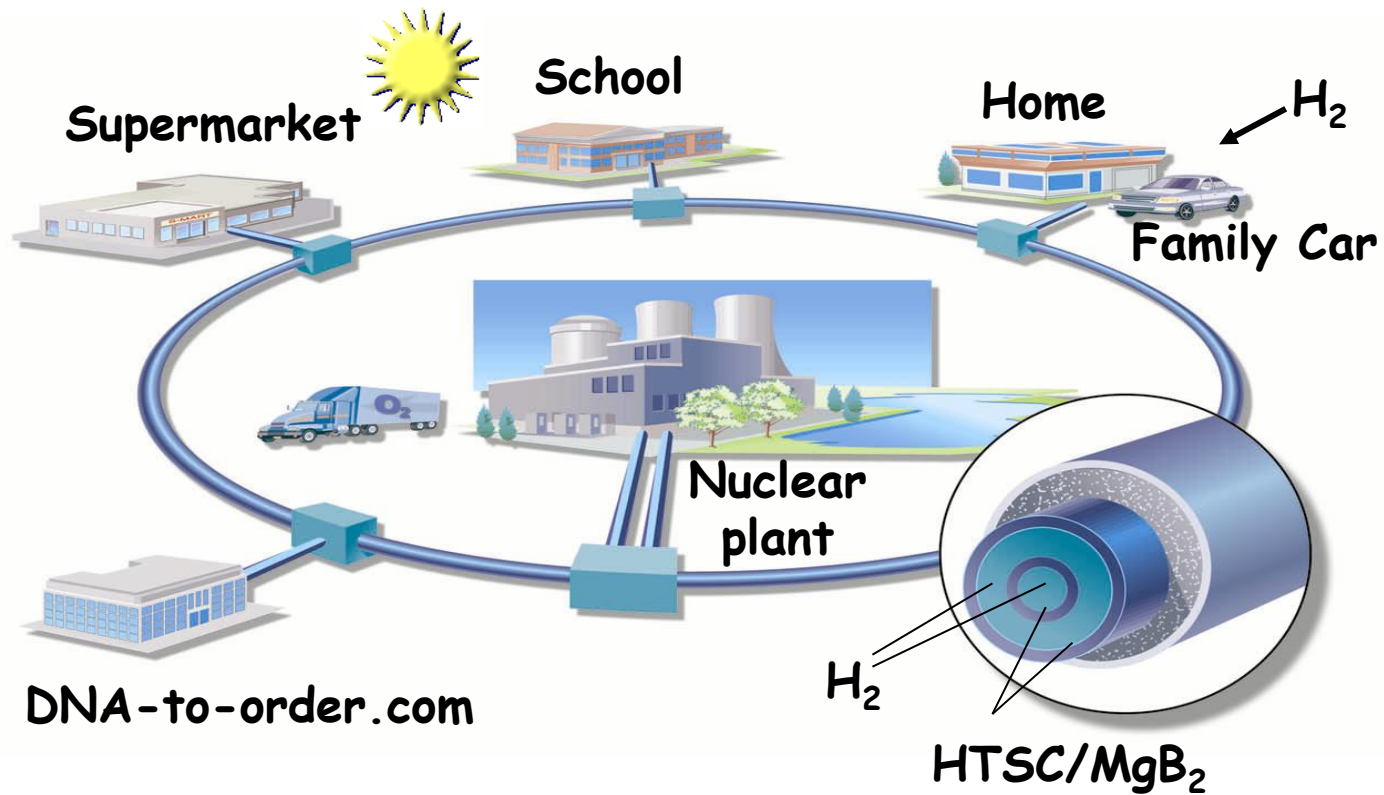


P.M. Grant, The Industrial Physicist, Feb/March Issue, 2002

Diablo Canyon




California Coast Power

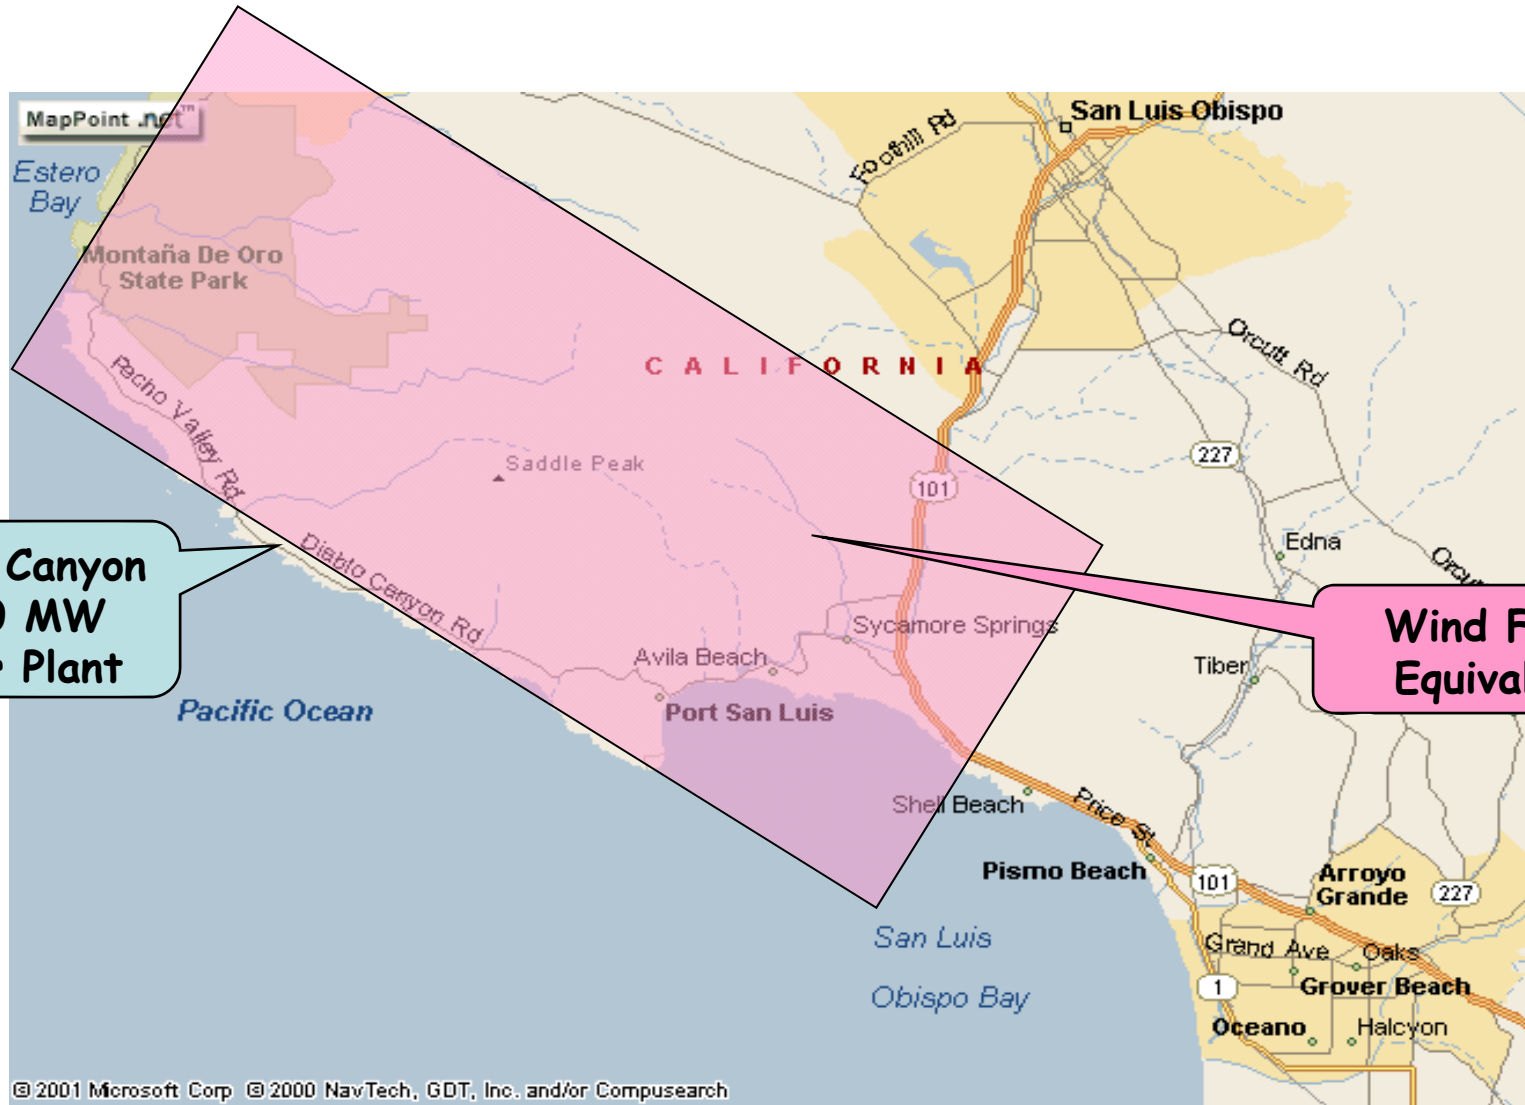

Diablo Canyon
2200 MW
Power Plant


Wind Farm
Equivalent

Co-Production of Hydrogen and Electricity

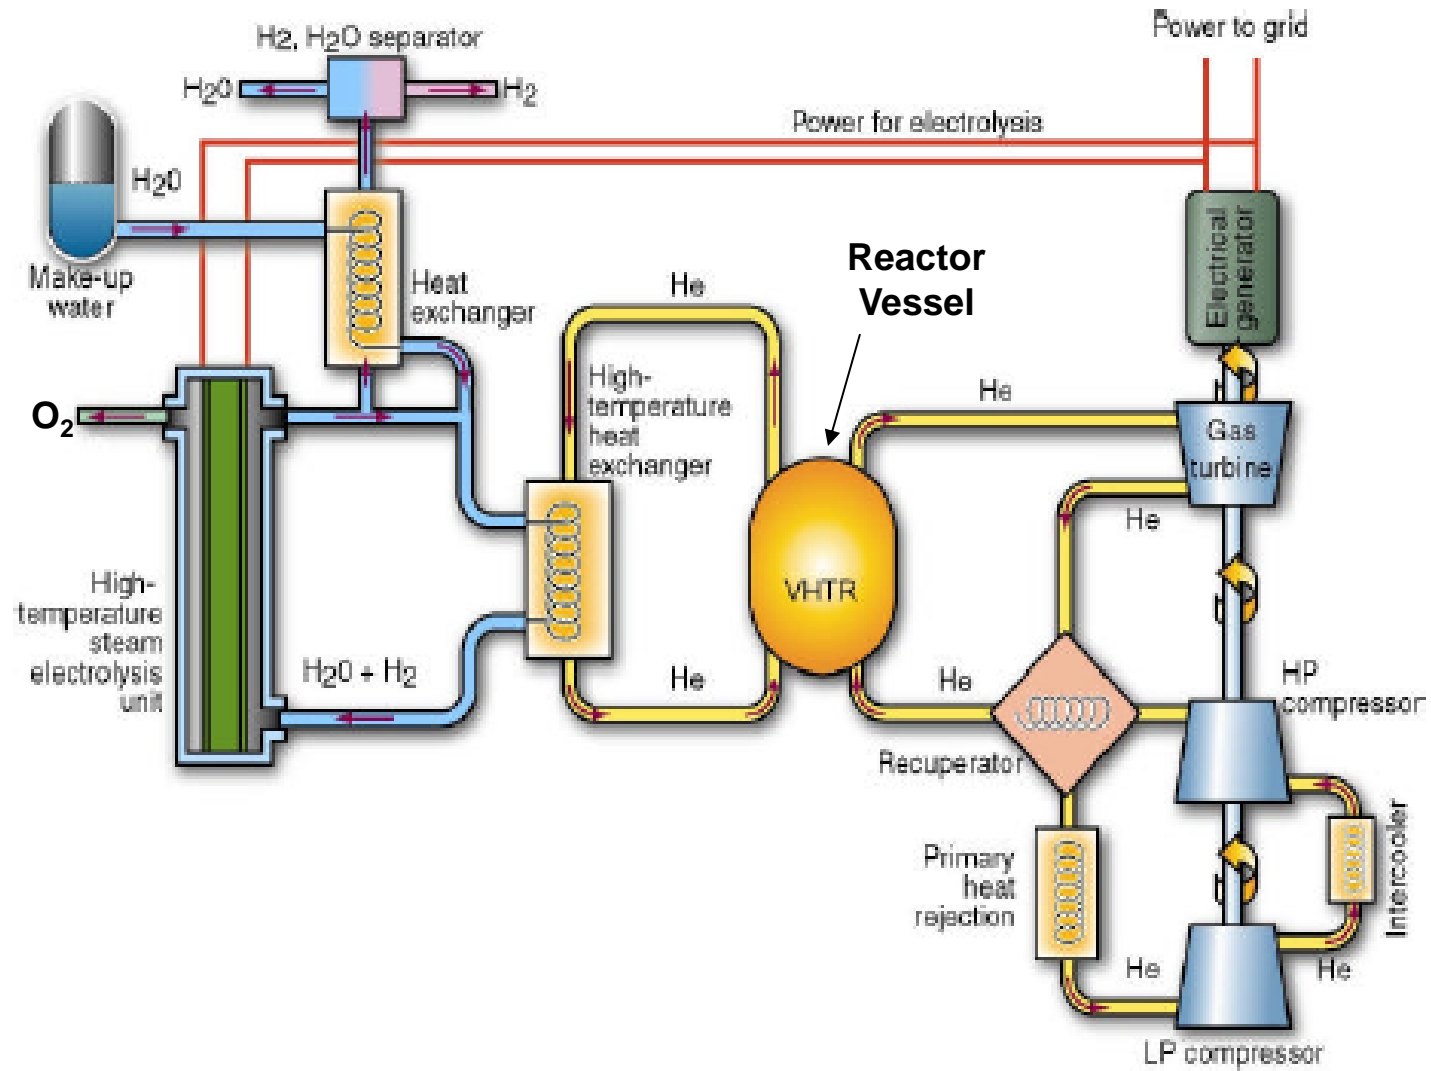


Source: INEL & General Atomics

Nuclear “Hydricity” Production Farm

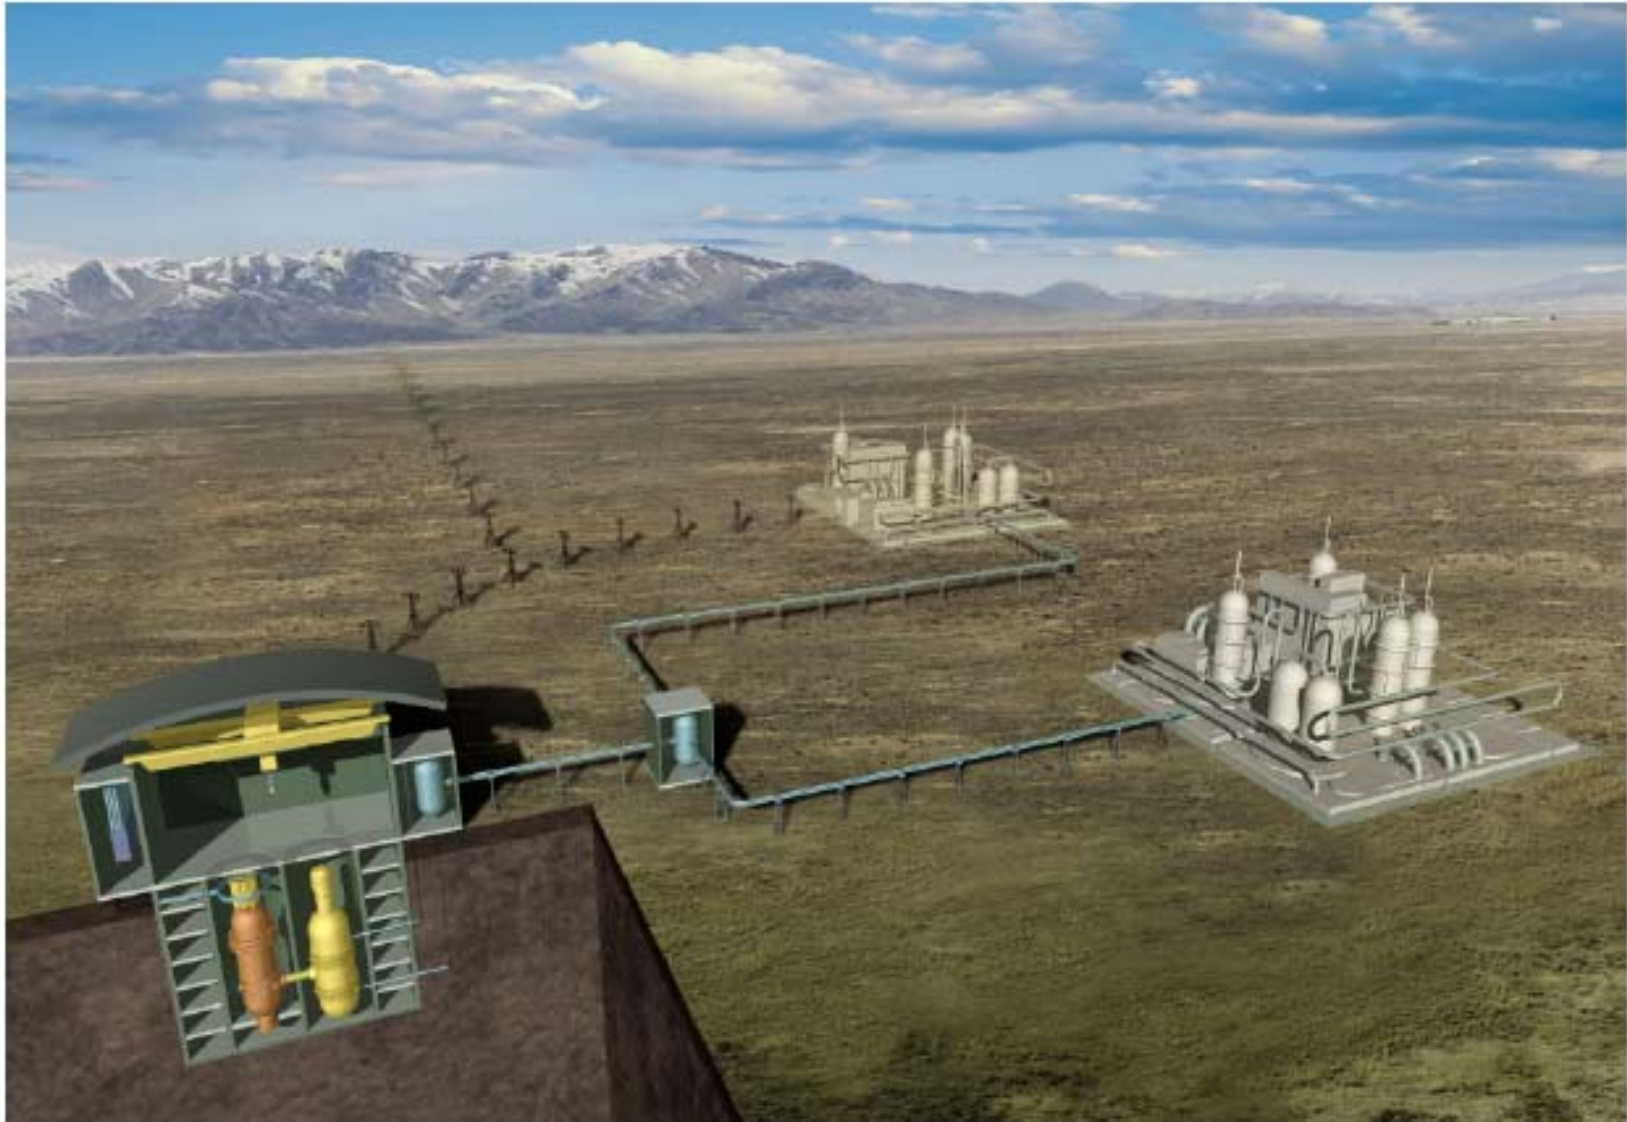


Source: General Atomics

The Discovery of Superconductivity

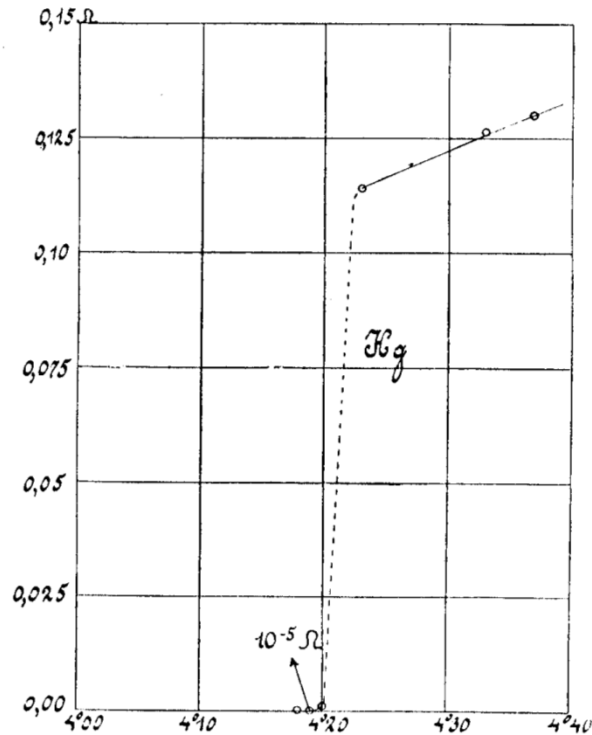


Leiden, 1914

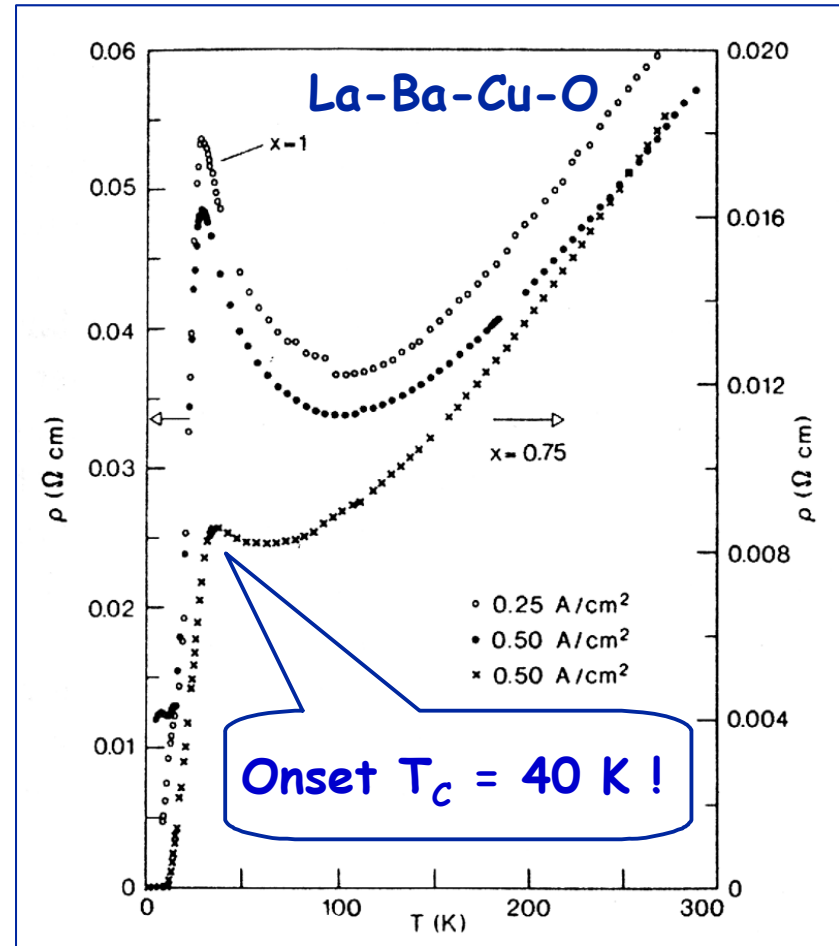


Zürich, 1986


T_c vs Year: 1991 - 2001

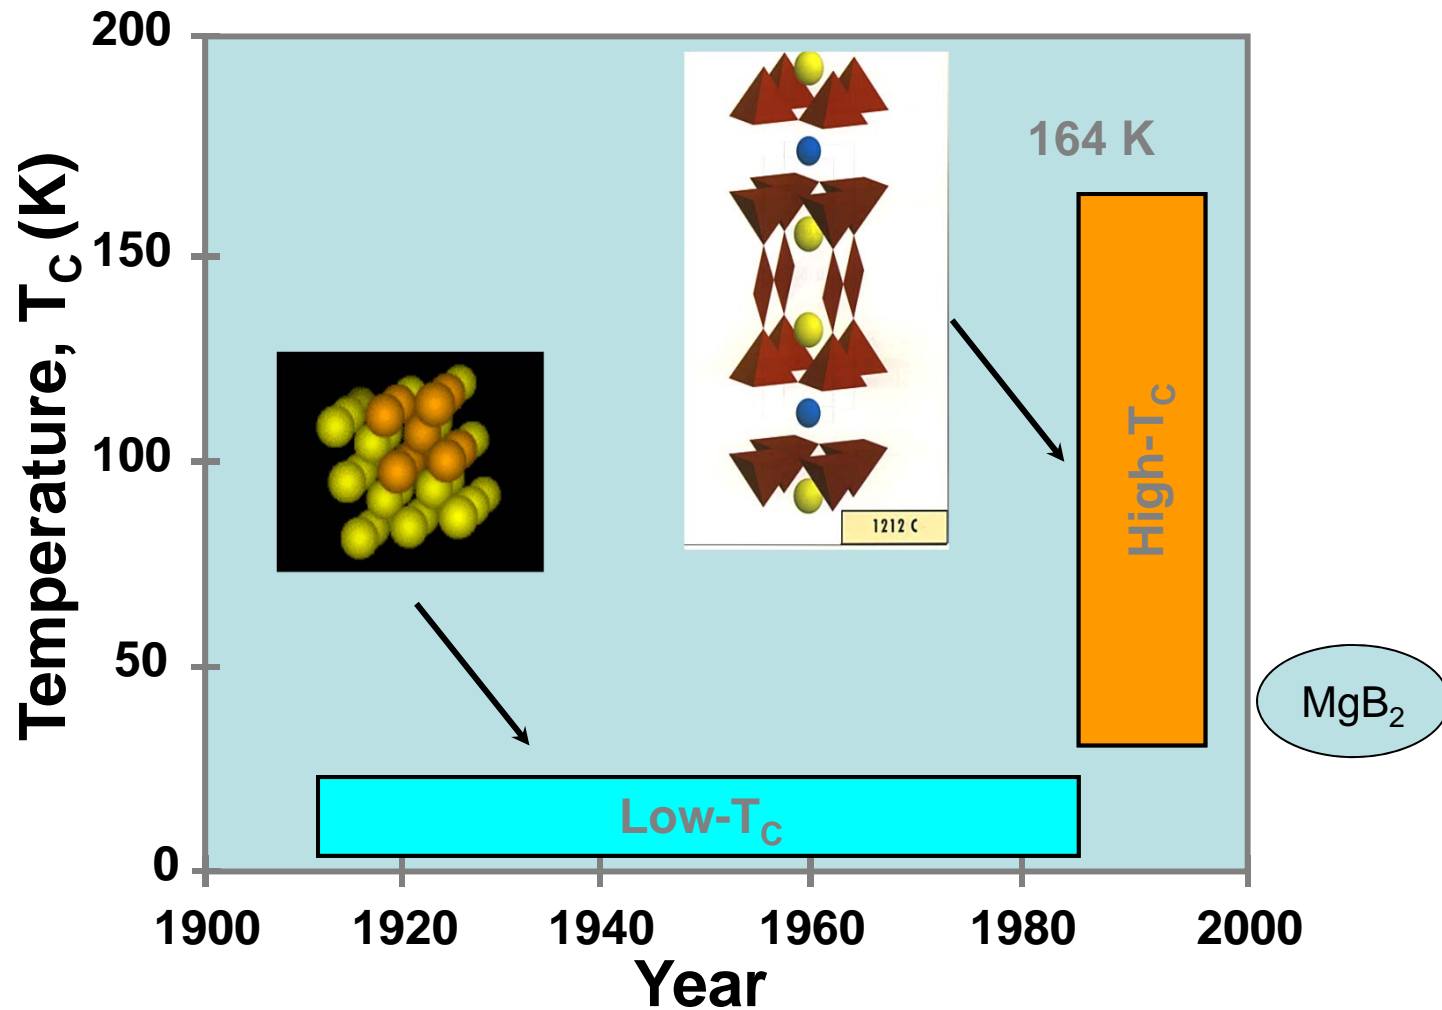

HTSC Wire Can Be Made!

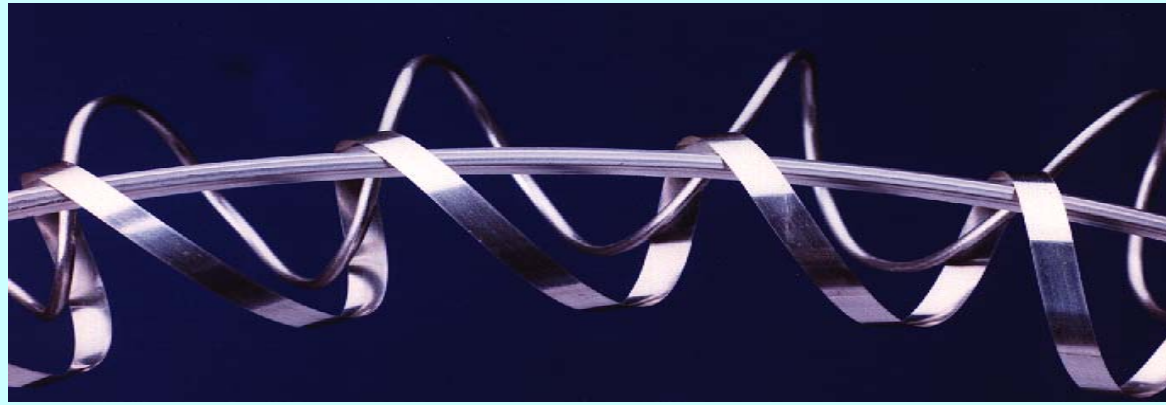


But it's 70% silver!

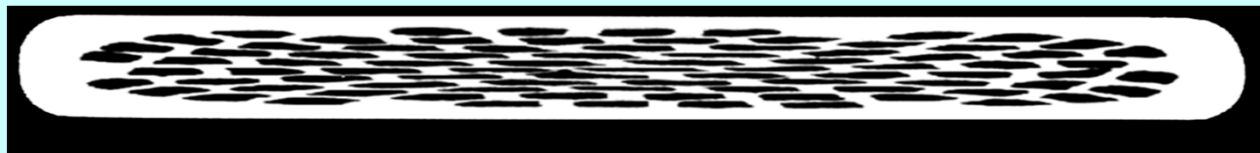

Finished Cable



Innost/Innopower Cable

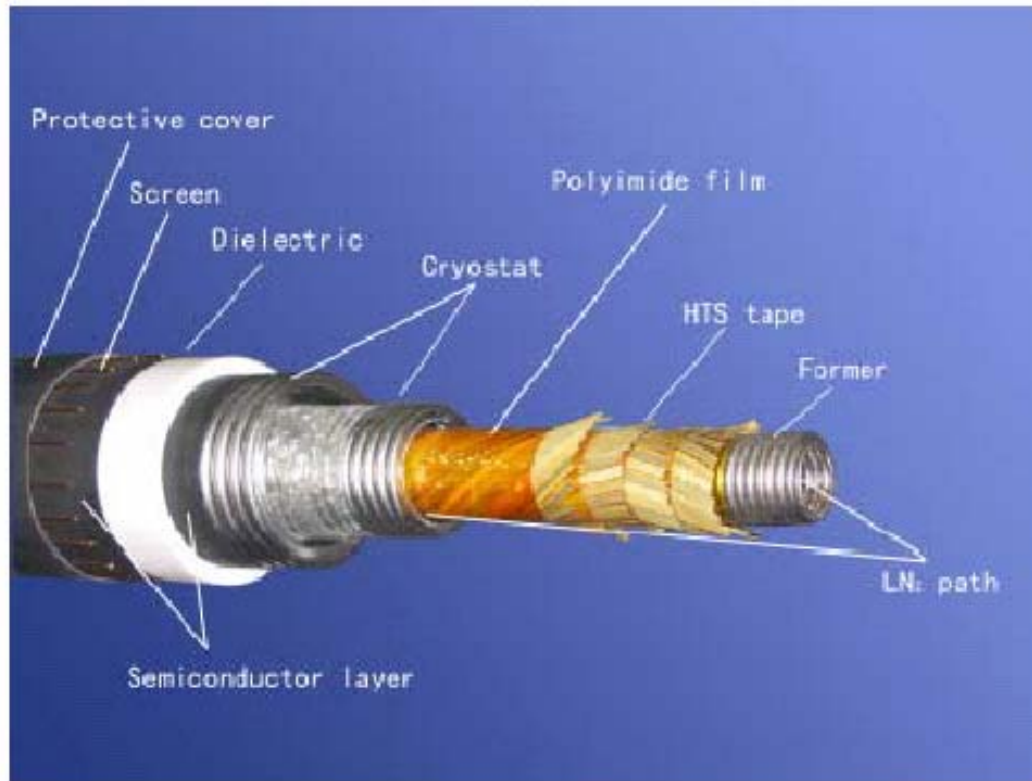

Former ID/OD(with Braiding):

30/35 mm

Layers of HTS tape:

4

Number of HTS tape:

90(21,24,24,21)

Ic of HTS tape:

60-80 A (77K, self field)

ID/OD of cryostat:

43/70 mm

Dielectric material:

XLPE

Thickness of dielectric:

11.9mm

Overall linear specific weight:

9.2kg/m

Puji Substation (Kunming City)



Reading Assignment

1. [Garwin and Matisoo](#), 1967 (100 GW on Nb₃Sn)
2. [Bartlit, Edeskuty and Hammel](#), 1972 (LH₂, LNG and 1 GW on LTSC)
3. [Haney and Hammond](#), 1977 (Slush LH₂ and Nb₃Ge)
4. [Schoenung, Hassenzahl and Grant](#), 1997 (5 GW on HTSC, 1000 km)
5. [Grant](#), 2002 (SuperCity, Nukes+LH₂+HTSC)
6. [Proceedings](#), SuperGrid Workshop, 2002

These articles, and much more, can be found at www.w2agz.com, sub-pages [SuperGrid/Bibliography](#)

1967: SC Cable Proposed!

538

PROCEEDINGS OF THE IEEE, VOL. 55, NO. 4, APRIL 1967

Superconducting Lines for the Transmission of Large Amounts of Electrical Power over Great Distances

R. L. GARWIN AND J. MATISOO

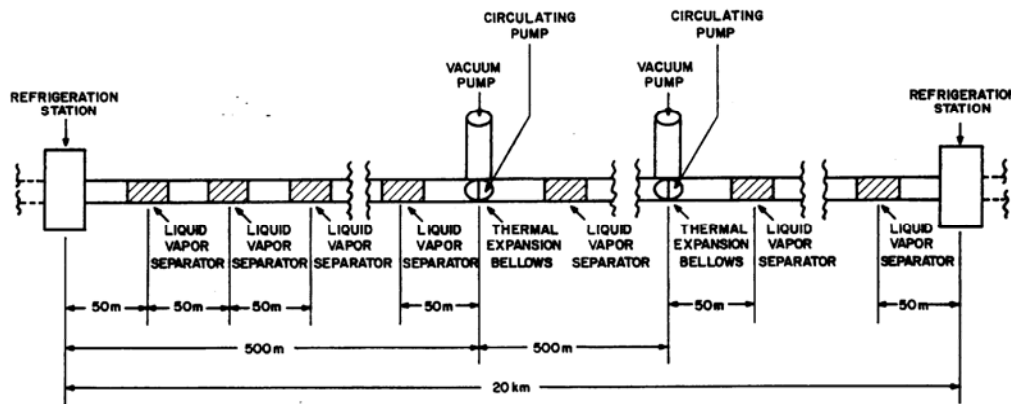


Fig. 2. A 20-km module of the 1000-km, 100-GW line.


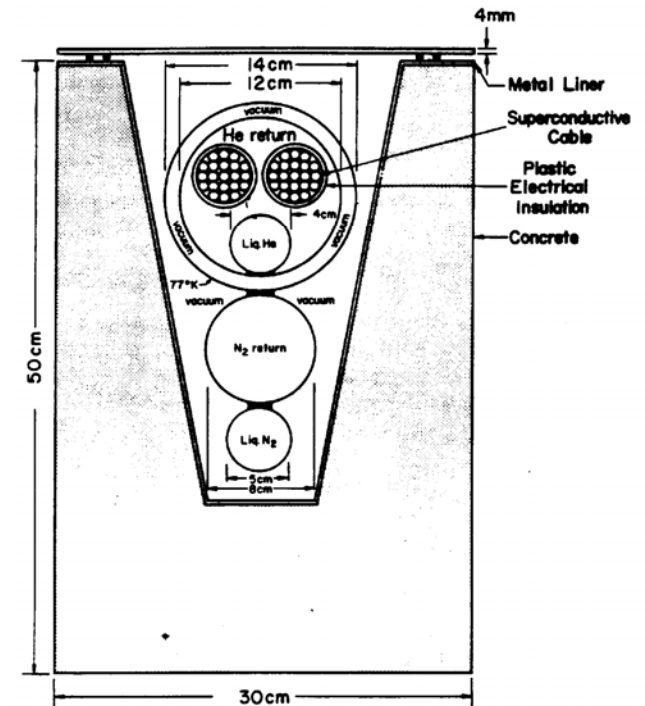



Fig. 1. Cross section of the 100-GW line.

100 GW dc, 1000 km !

“Hydricity” SuperCables

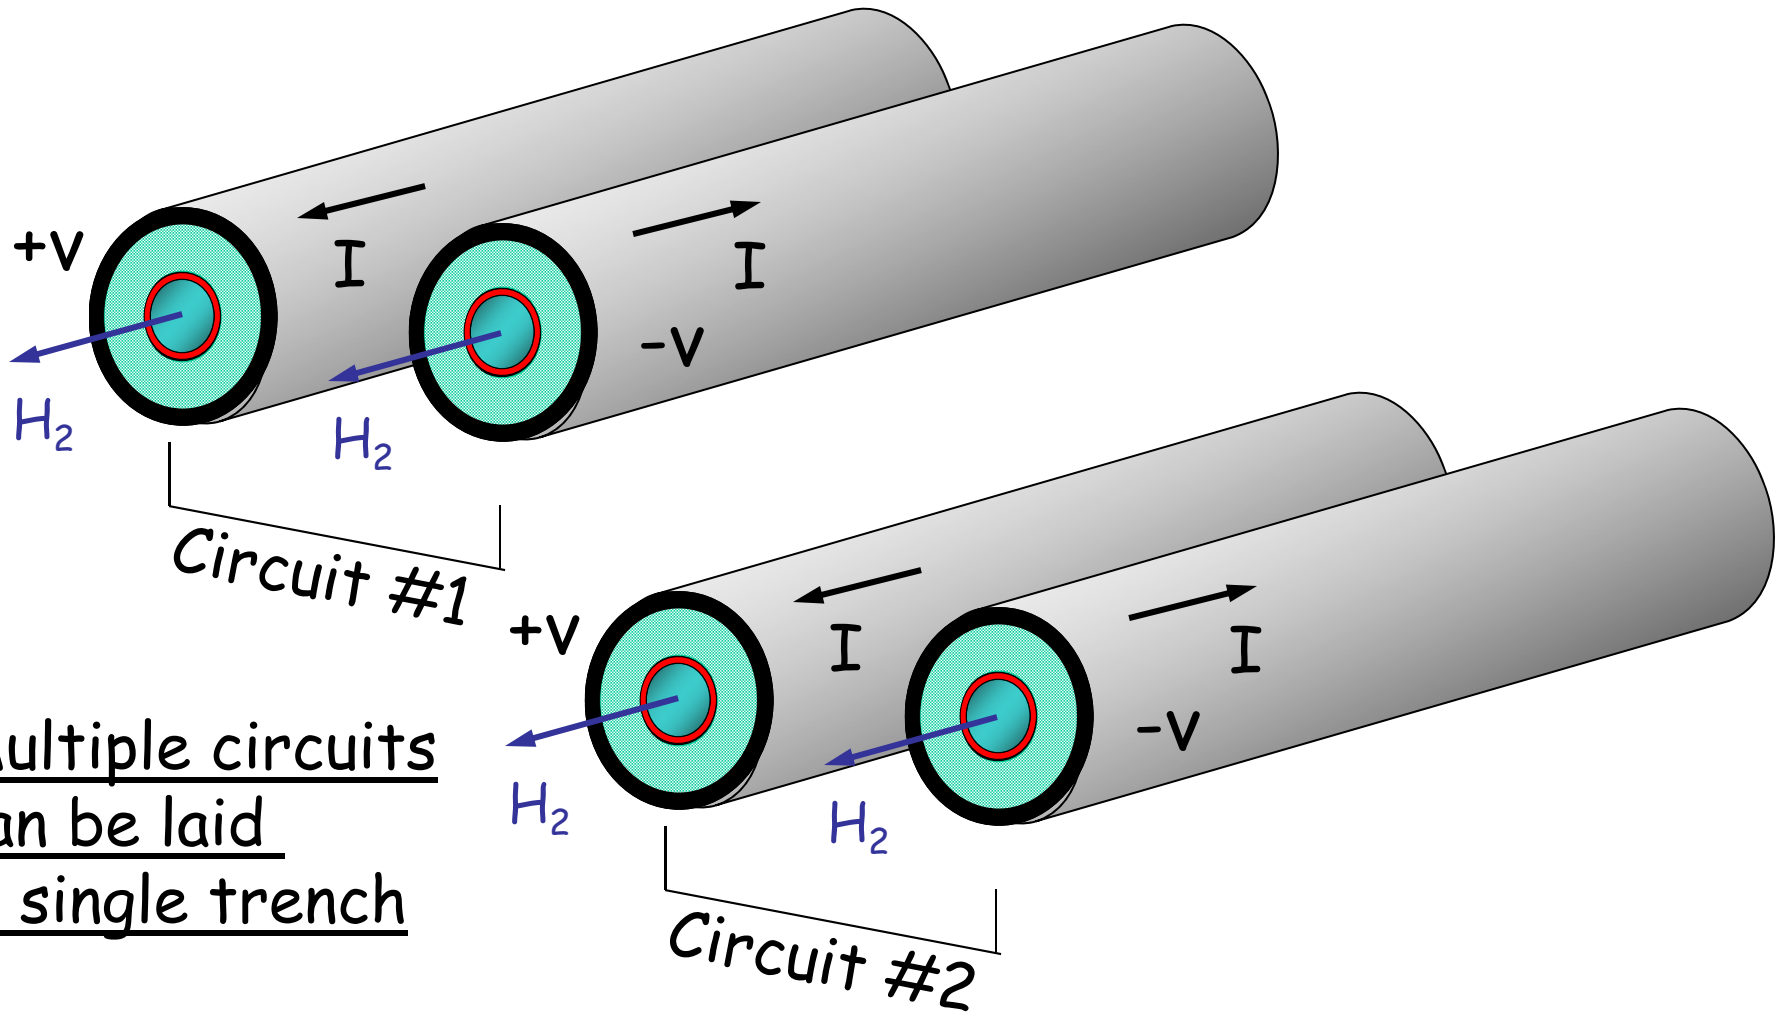

SuperCable

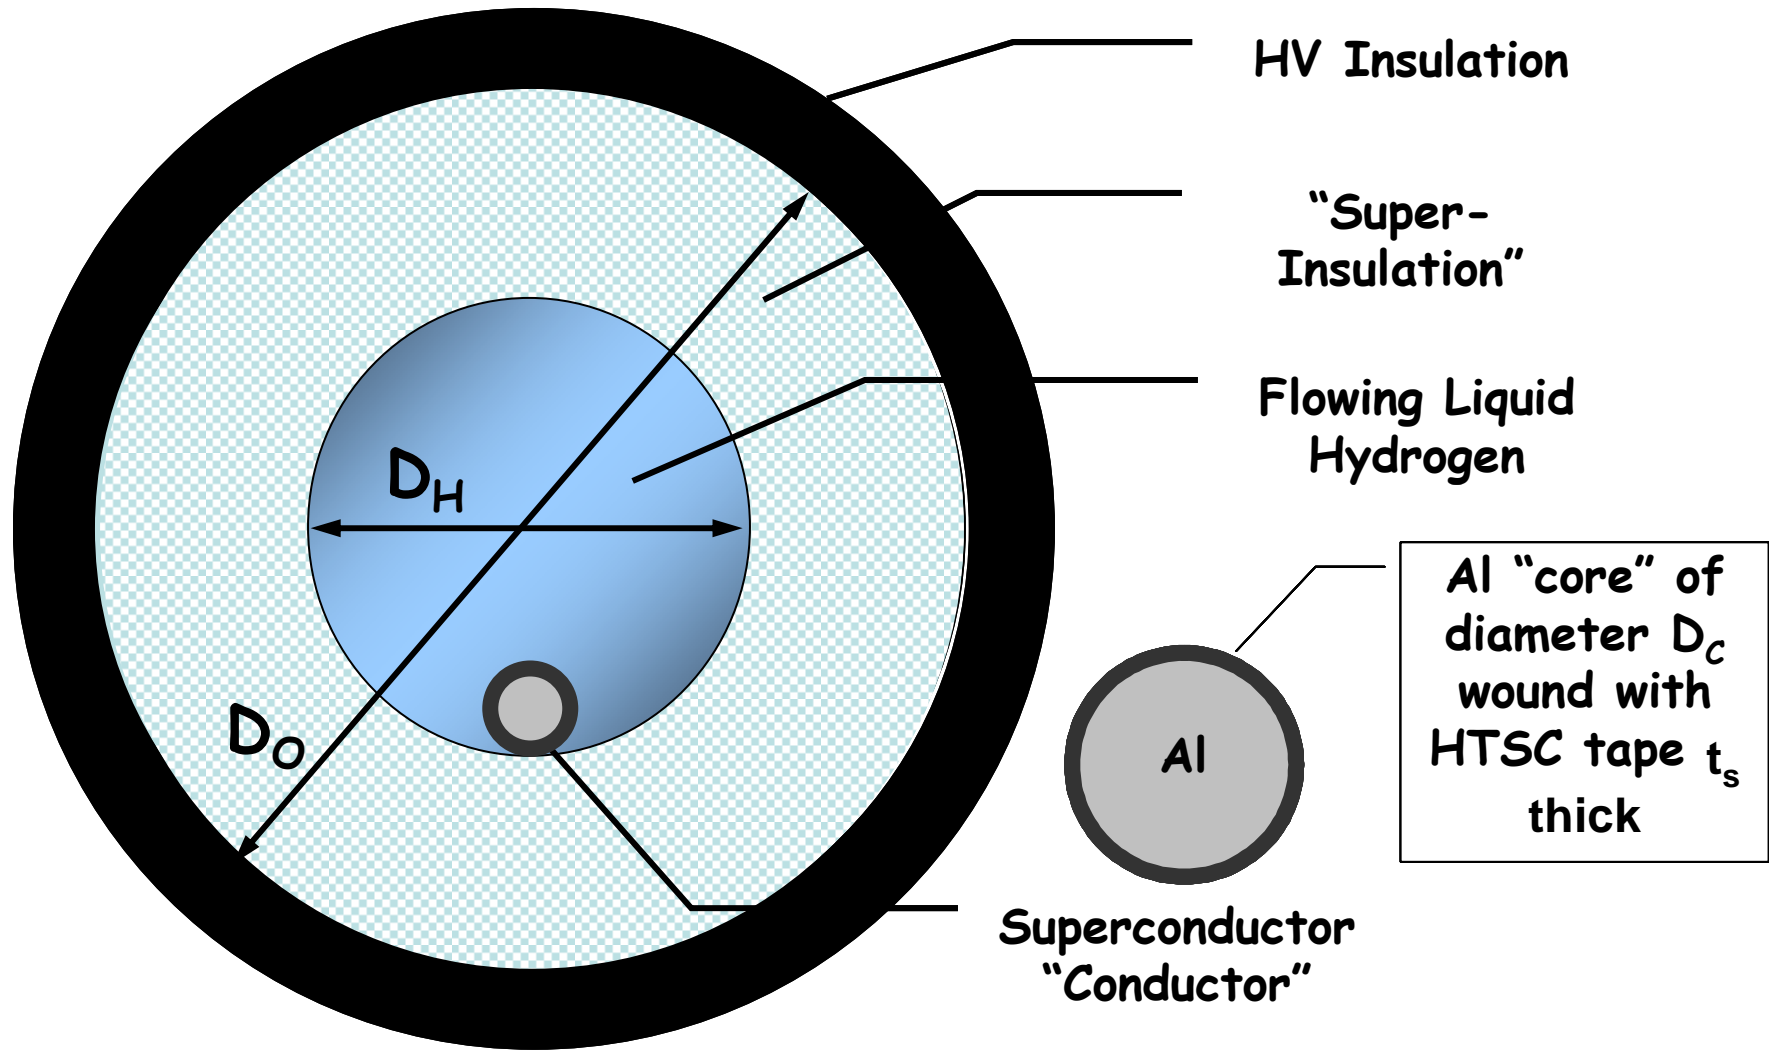

Power Flows

$$P_{SC} = 2|V|JA_{SC}, \text{ where}$$

Electricity

P_{SC} = Electric power flow

V = Voltage to neutral (ground)

J = Supercurrent density

A_{SC} = Cross-sectional area of superconducting annulus

$$P_{H_2} = 2(Q\rho vA)_{H_2}, \text{ where}$$

Hydrogen

P_{H_2} = Chemical power flow

Q = Gibbs H_2 oxidation energy (2.46 eV per mol H_2)

ρ = H_2 Density

v = H_2 Flow Rate

A = Cross-sectional area of H_2 cryotube

Power Flows: $5 \text{ GW}_e / 10 \text{ GW}_{th}$

Electrical Power Transmission (+/- 25 kV)				
Power (MW_e)	Current (A)	HTS J_c (A/cm^2)	D_c (cm)	t_s (cm)
5,000	100,000	25,000	3.0	0.38

HV Insulation


"Super-Insulation"

Flowing Liquid Hydrogen

Al "core" of diameter D_c wound with HTSC tape t_s thick

Chemical Power Transmission (H_2 at 20 K, per "pole")			
Power (MW_{th})	D_H -effective (cm)	H_2 Flow (m/s)	D_H -actual (cm)
5,000	40	4.76	45.3

or

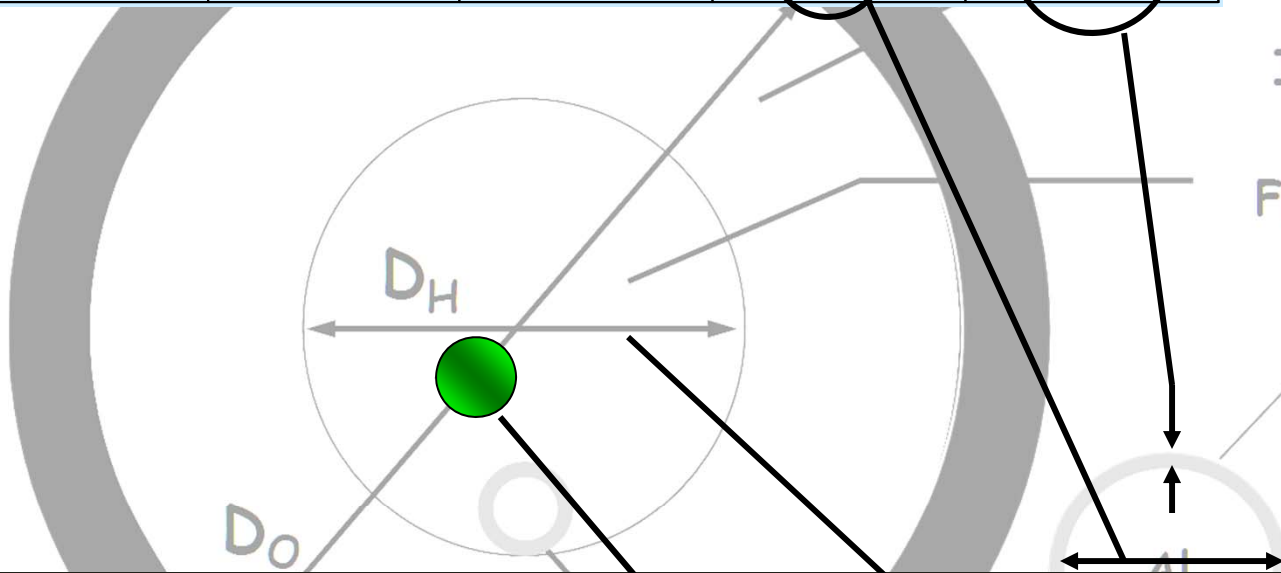

Radiation Losses

$$W_R = 0.5\varepsilon\sigma (T_{\text{amb}}^4 - T_{\text{SC}}^4), \text{ where}$$

W_R = Power radiated in as watts/unit area

$$\sigma = 5.67 \times 10^{-12} \text{ W/cm}^2\text{K}^4$$

$$T_{\text{amb}} = 300 \text{ K}$$

$$T_{\text{SC}} = 20 \text{ K}$$

$\varepsilon = 0.05$ per inner and outer tube surface

$$D_H = 45.3 \text{ cm}$$

$$W_R = 16.3 \text{ W/m}$$

Superinsulation: $W_R^f = W_R/(n-1)$, where

n = number of layers = 10

Net Heat In-Leak Due to Radiation = 1.8 W/m

Fluid Friction Losses

$$p_{loss} = \lambda (l / d_h) (\rho v^2 / 2)$$

$$W_{loss} = M P_{loss} / \rho,$$

where

Where M = mass flow per unit length

P_{loss} = pressure loss per unit length

ρ = fluid density

p_{loss} = pressure loss (Pa, N/m²)

λ = friction coefficient

$$1 / \lambda^{1/2} = -2,0 \log_{10} [(2,51 / (Re \lambda^{1/2})) + (\epsilon / d_h) / 3,72]$$

l = length of duct or pipe (m)

d_h = hydraulic diameter (m)

Fluid	Re	ϵ (mm)	D_H (cm)	v (m/s)	ΔP (atm/10 km)	Power Loss (W/m)
H (20K)	2.08 x 10 ⁶	0.015	45.3	4.76	2.0	3.2

Heat Removal

$$dT/dx = W_T / (\rho v C_p A)_{H_2}, \text{ where}$$

dT/dx = Temp rise along cable, K/m

W_T = Thermal in-leak per unit Length

ρ = H_2 Density

v = H_2 Flow Rate

C_p = H_2 Heat Capacity

A = Cross-sectional area of H_2 cryotube


SuperCable Losses (W/M)					K/10km
Radiative	Friction	ac Losses	Conductive	Total	dT/dx
1.8	3.2	1	1	7	10^{-2}

SuperCable H₂ Storage

<u><i>Some Storage Factoids</i></u>	Power (GW)	Storage (hrs)	Energy (GWh)
TVA Raccoon Mountain	1.6	20	32
Scaled ETM SMES	1	8	8


One Raccoon Mountain = 13,800 cubic meters of LH₂

**LH₂ in 45 cm diameter, 20 km bipolar SuperCable
= Raccoon Mountain**

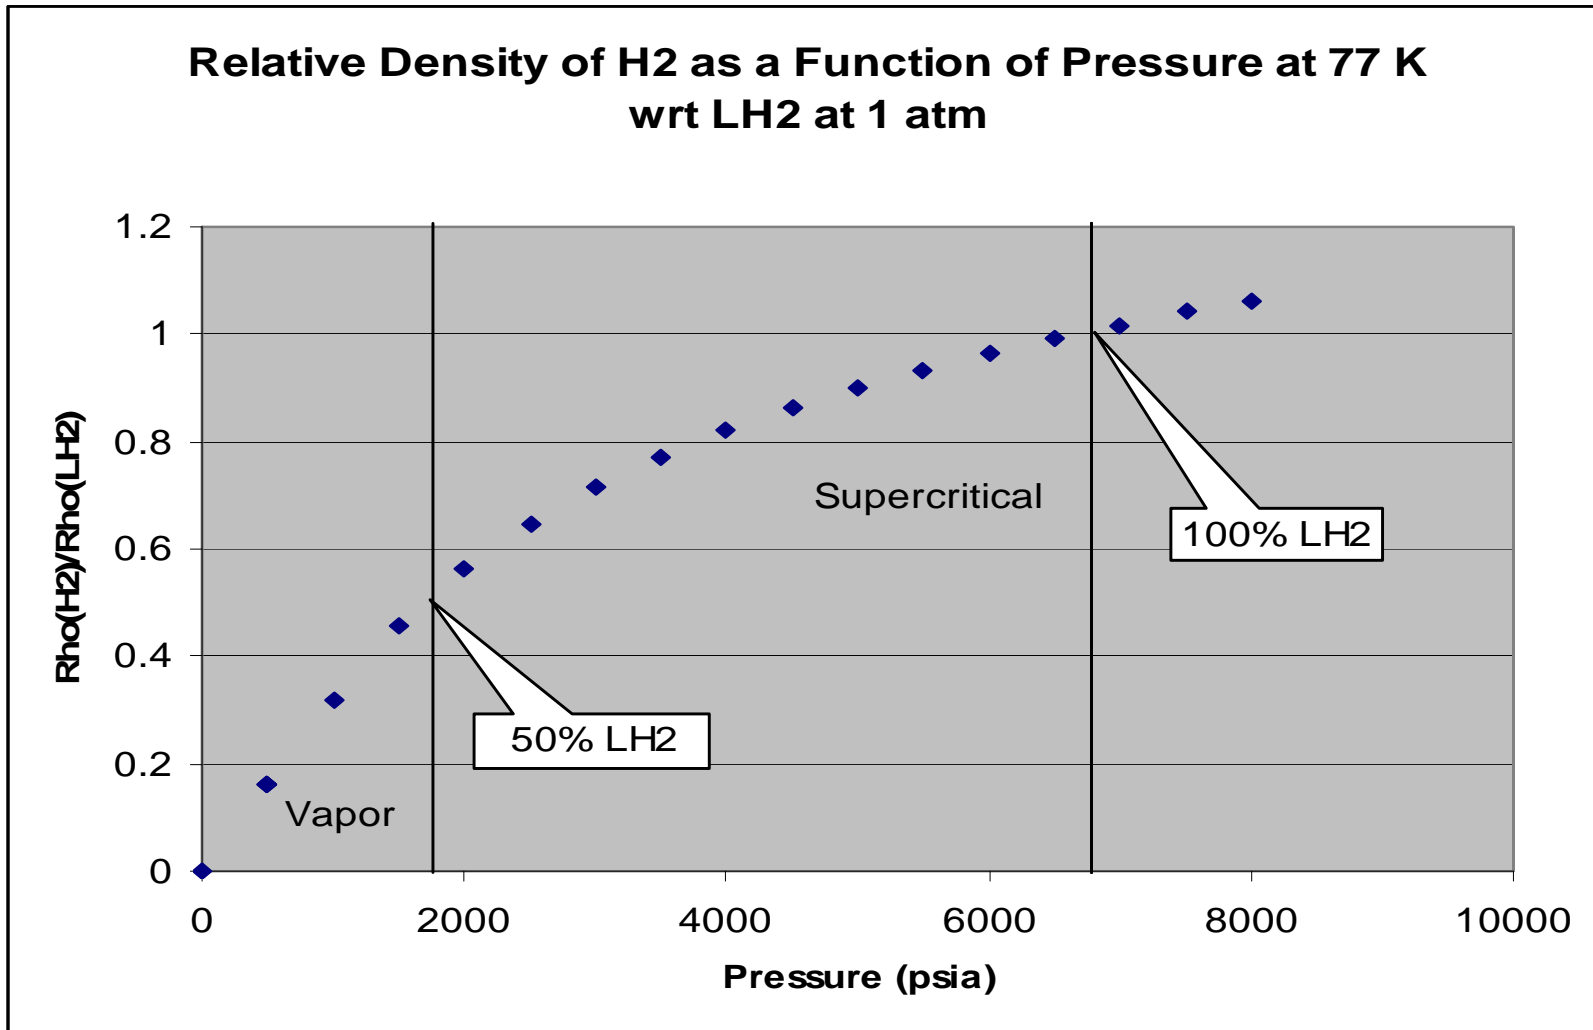


H₂ Gas at 77 K and 1850 psia has 50% of the energy content of liquid H₂ and 100% at 6800 psia

“Hybrid” SuperCable

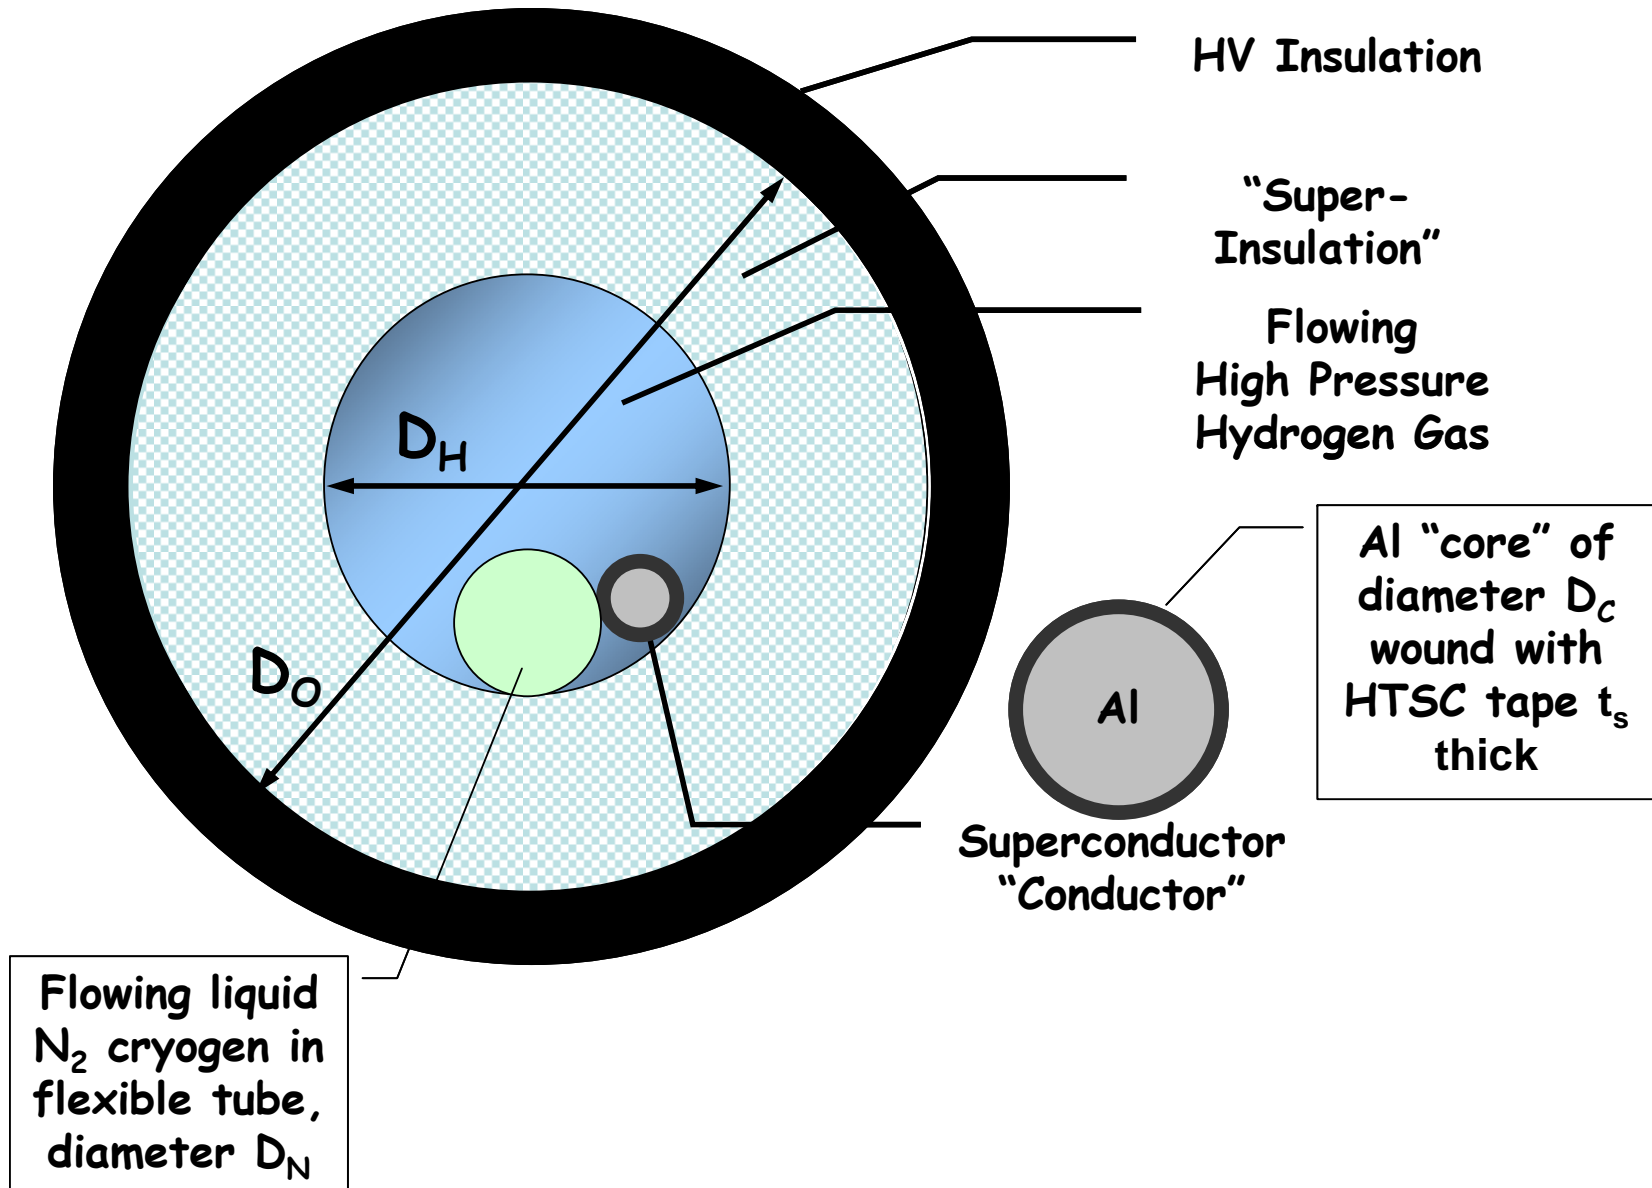

Electricity Generation - June 2004

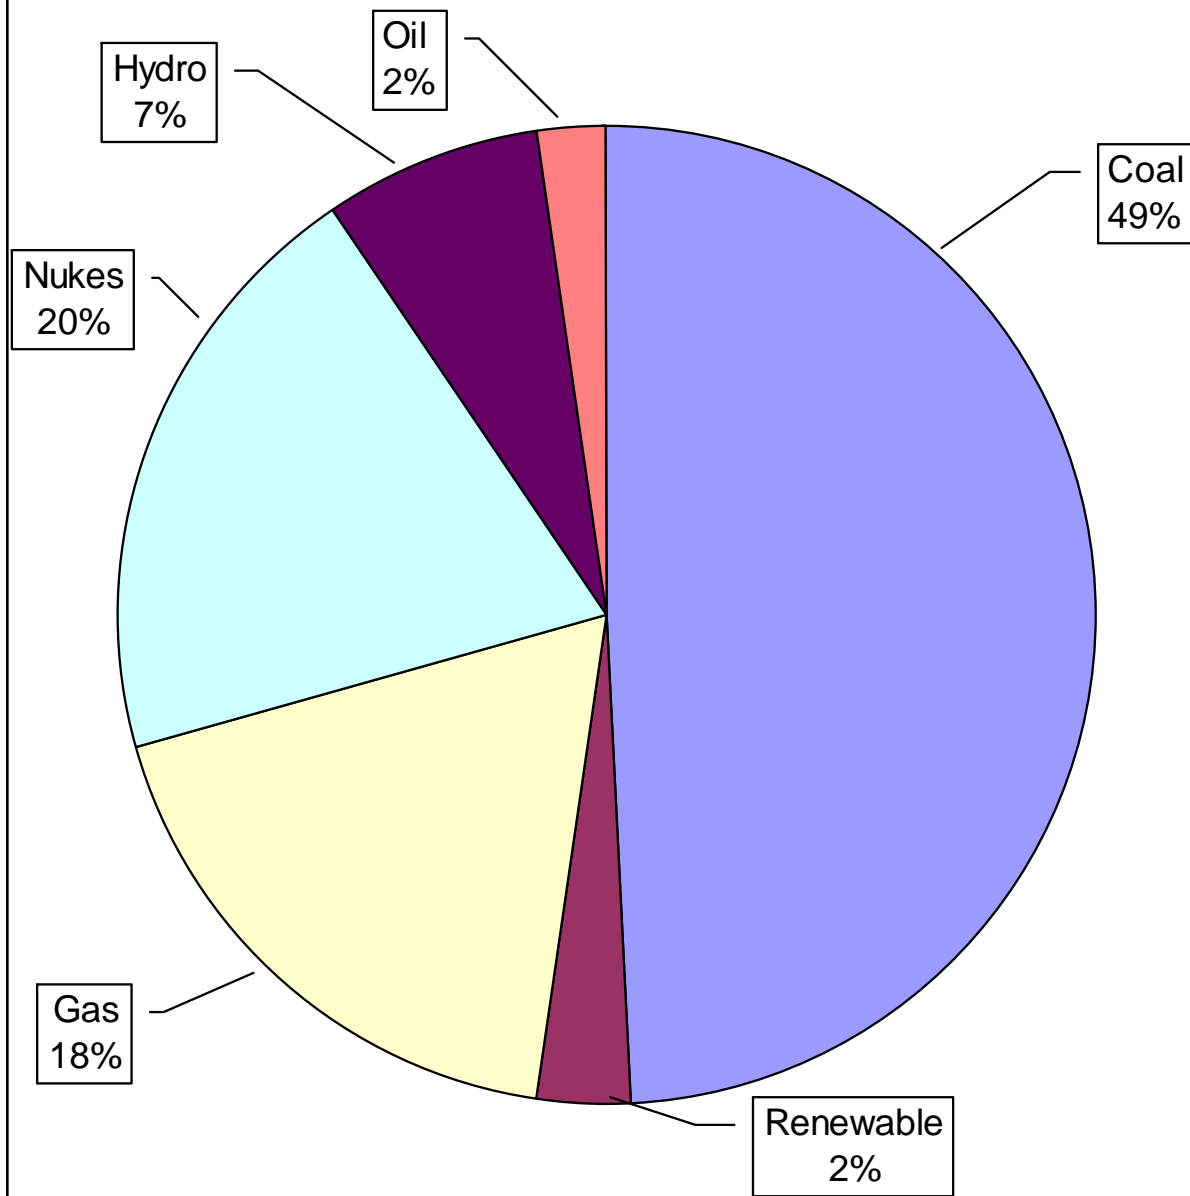




PROPOSED	
	Alaska Natural Gas Transportation System
	Trans-Alaska Gas System
	Northern Pipeline Route
	Central Pipeline Route
	Mackenzie Valley Pipeline
	Dempster Lateral
	Alternative LNG Export Route
EXISTING	
	Foothills Pipeline
	PG&E Transmission - NW
	Northern Border

Al-Can Gas Pipeline Proposals

Source for graphic:
 T.J. Glauthier,
 Deputy Secretary,
 U.S. Department of Energy,
 "Testimony to the Senate
 Committee on Energy and
 Natural Resources"
 (September 14, 2000).

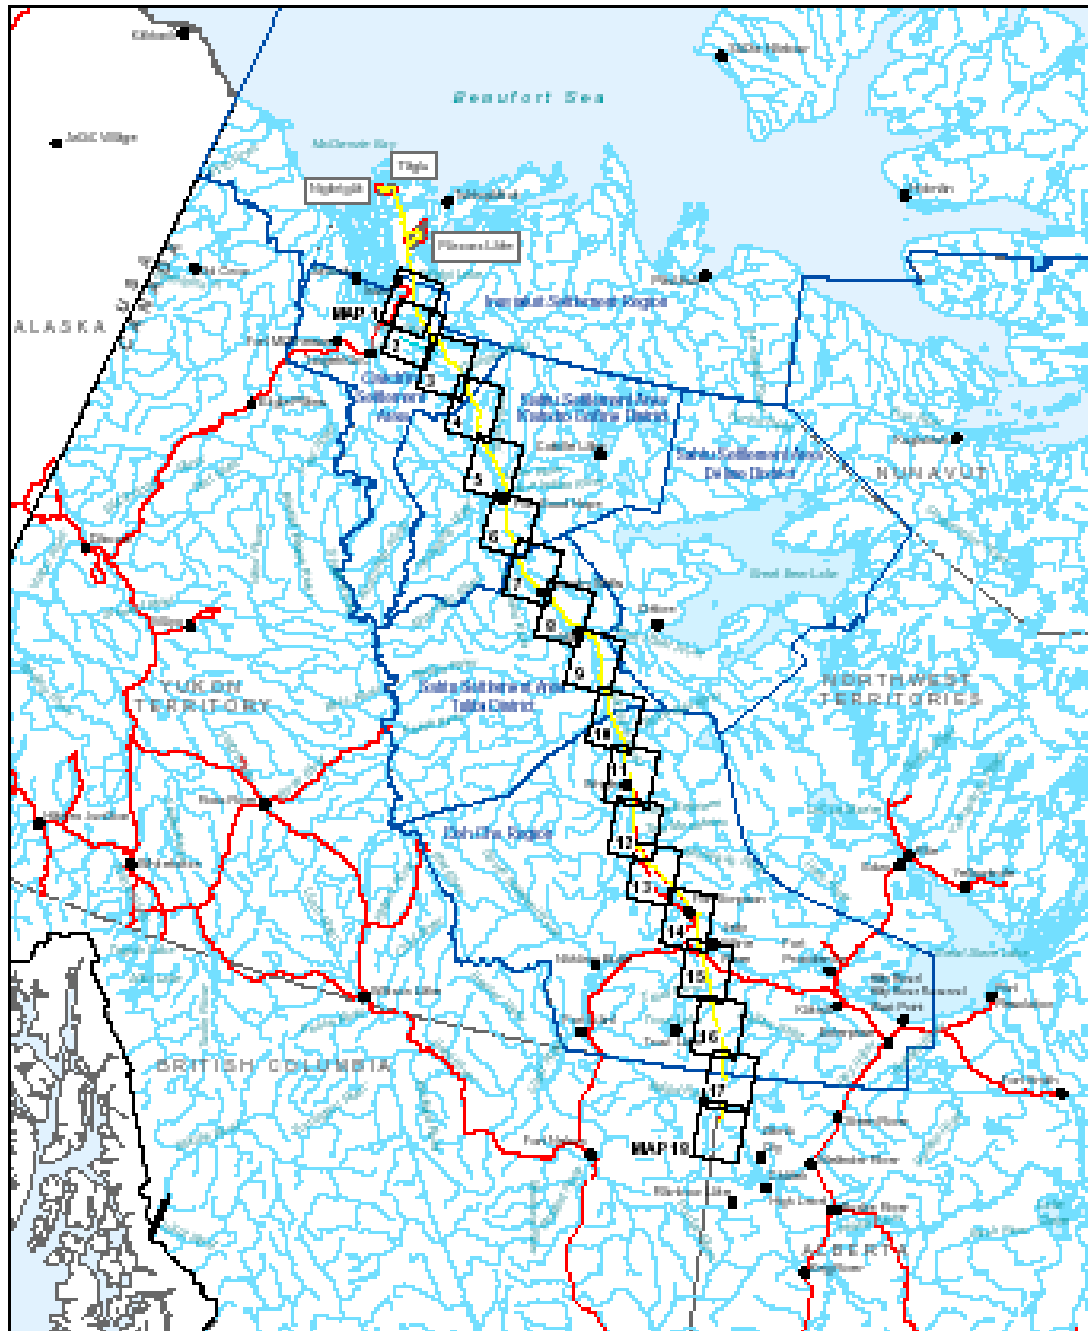


Mackenzie Valley Pipeline

1300 km

18 GW-thermal

LNG SuperCable

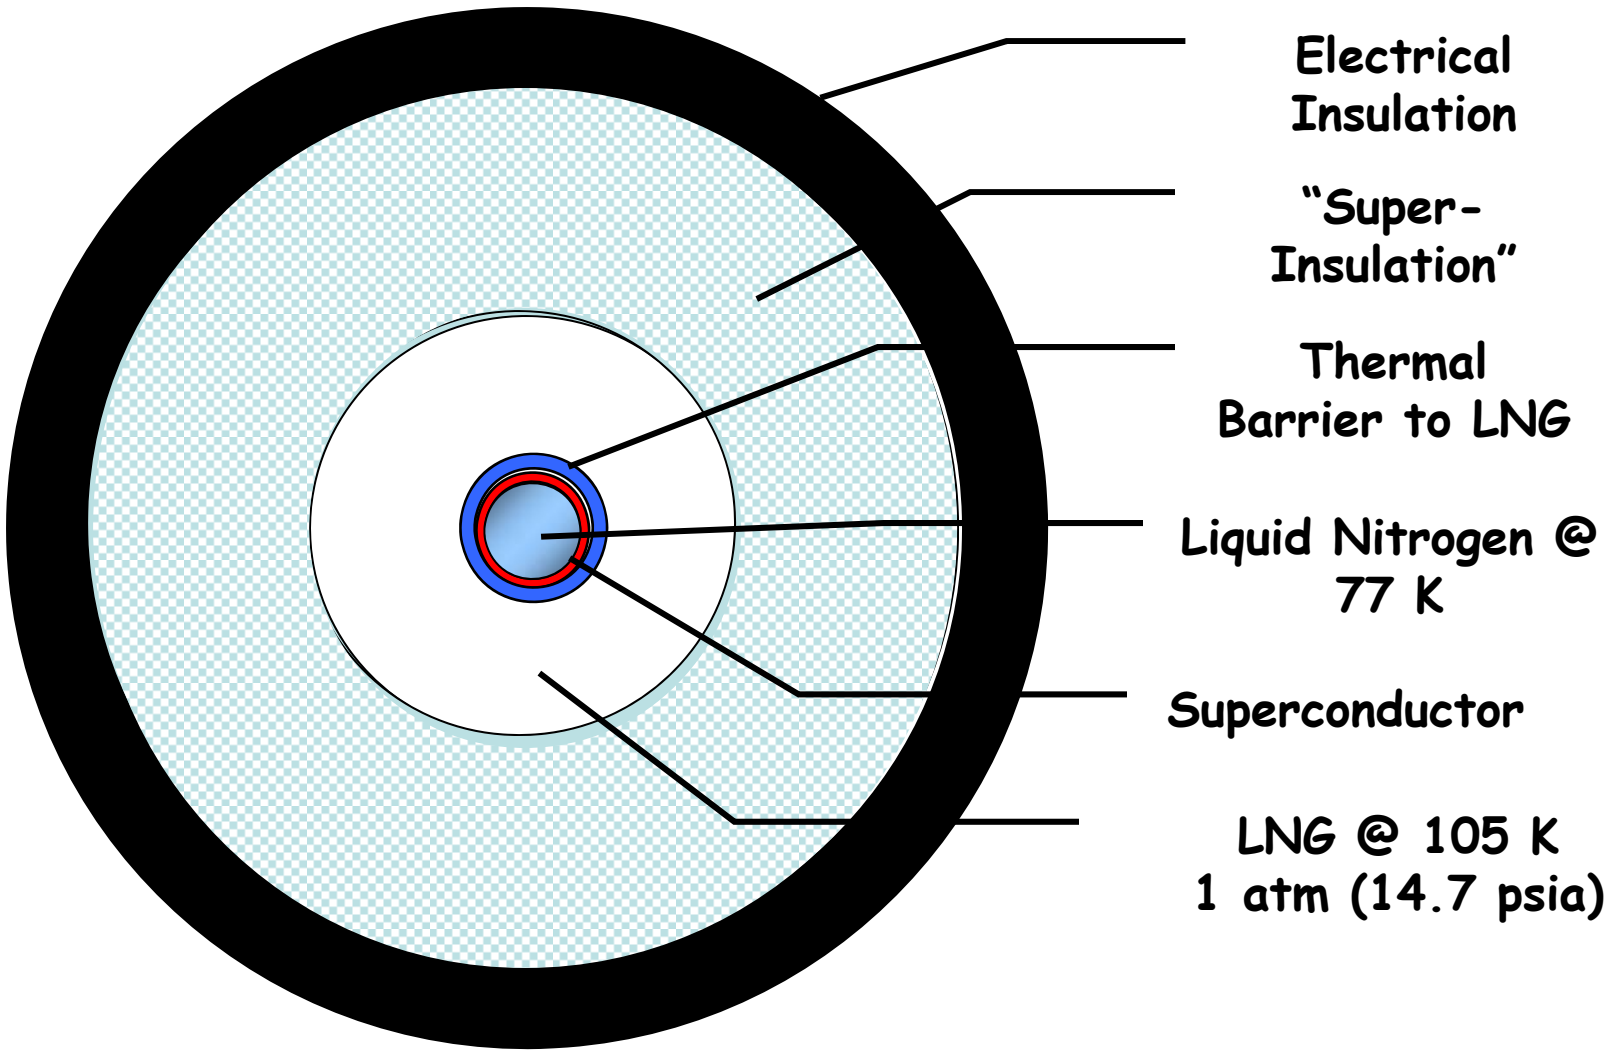


Electrical Issues

- Voltage – current tradeoffs
 - “Cold” vs “Warm” Dielectric
- AC interface (phases)
 - Generate dc? Multipole, low rpm units (aka hydro)
- Ripple suppression
 - Filters
- Cryogenics
 - Pulse Tubes
 - “Cryobreaks”
- Mag Field Forces
- Splices ($R = 0?$)
- Charge/Discharge cycles (Faults!)
- Power Electronics
 - GTOs vs IGBTs
 - 12” wafer platforms
 - Cryo-Bipolars

Construction Issues


- Pipe Lengths & Diameters (Transportation)
- Coax vs RTD
- Rigid vs Flexible?
- On-Site Manufacturing
 - Conductor winding (3-4 pipe lengths)
 - Vacuum: permanently sealed or actively pumped?
- Joints
 - Superconducting
 - Welds
 - Thermal Expansion (bellows)

SuperCable Prototype Project

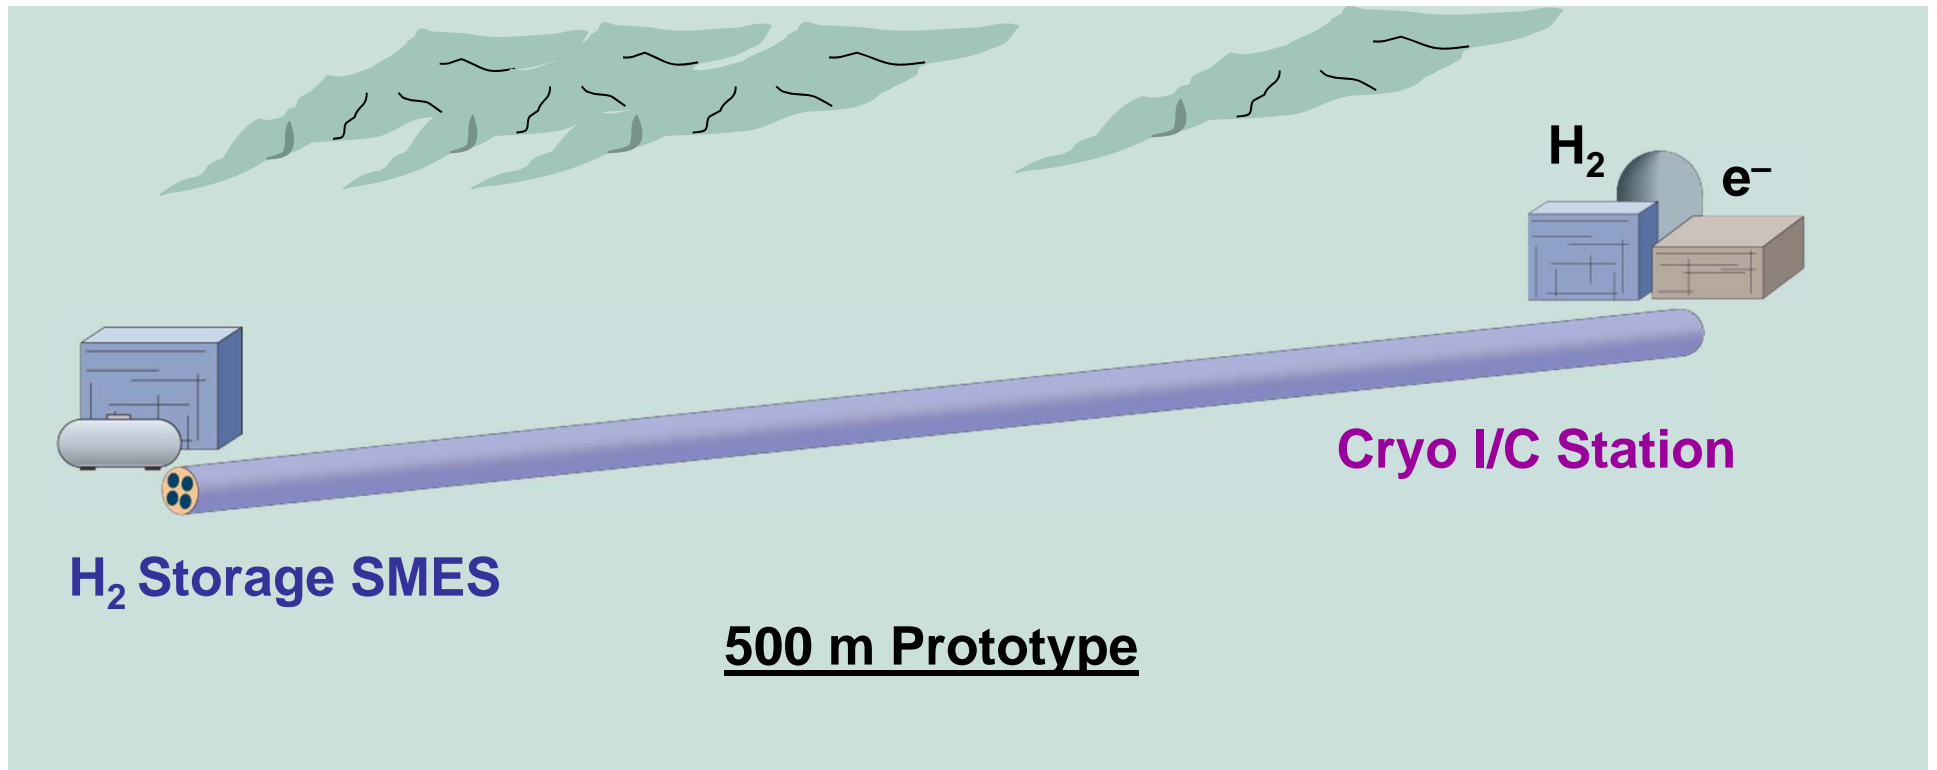


**“Appropriate National Laboratory”
2005-09**

Regional System Interconnections

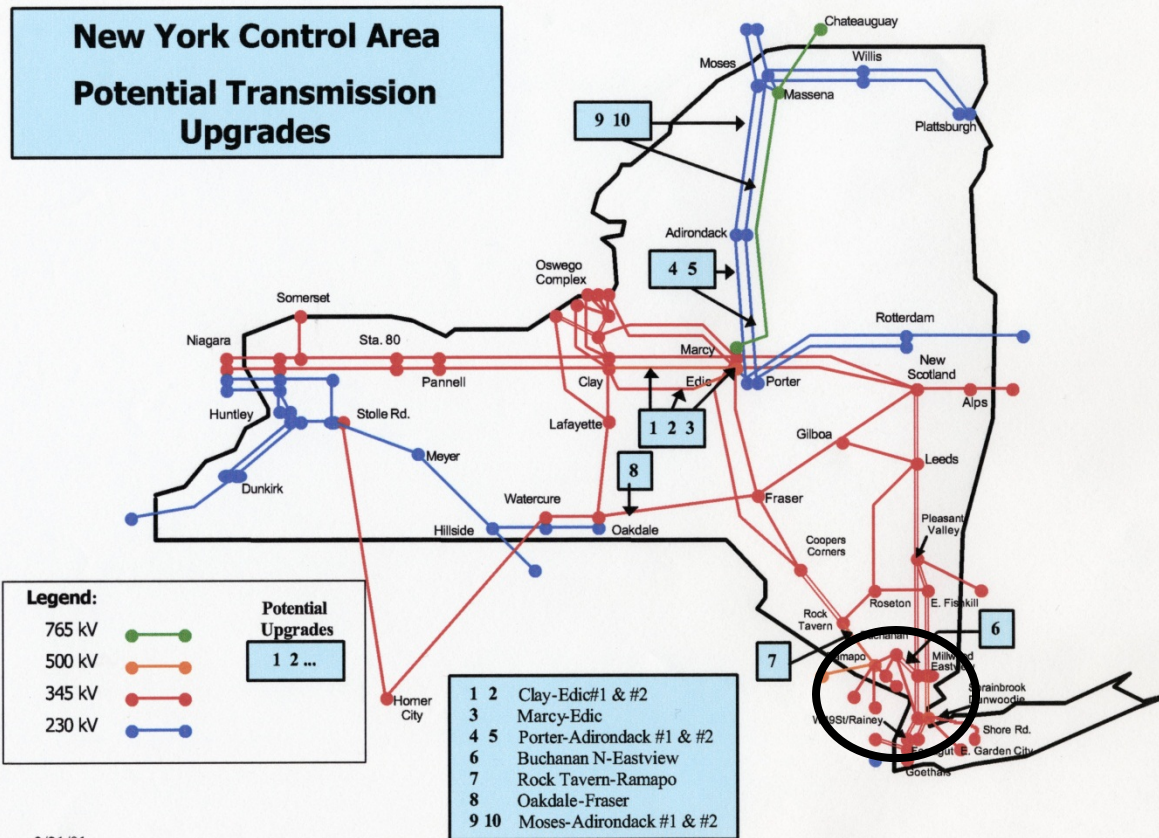



3/21/01

China: Present

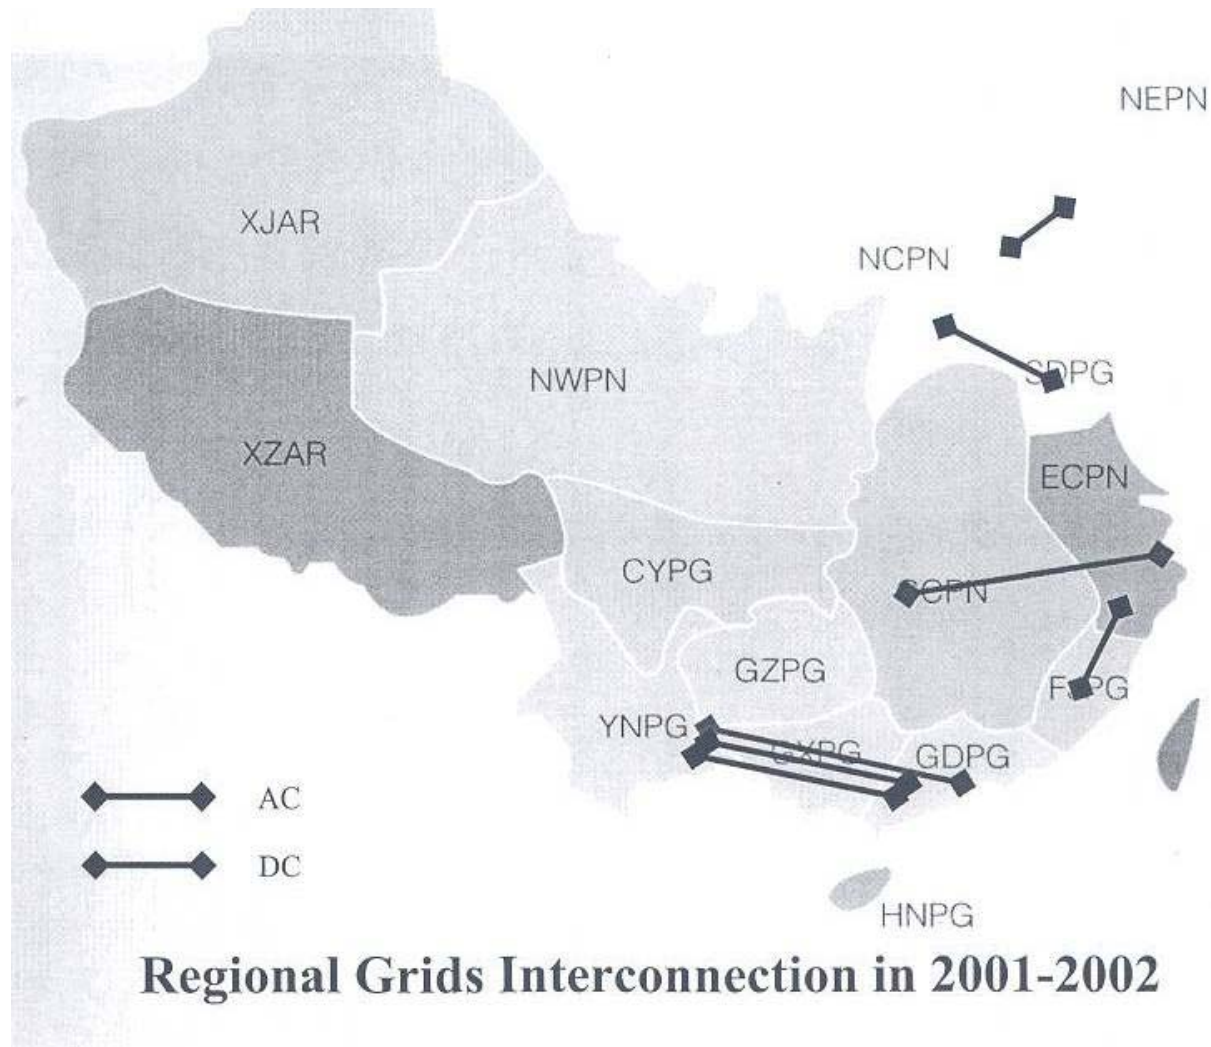

China: 2015 - 2020

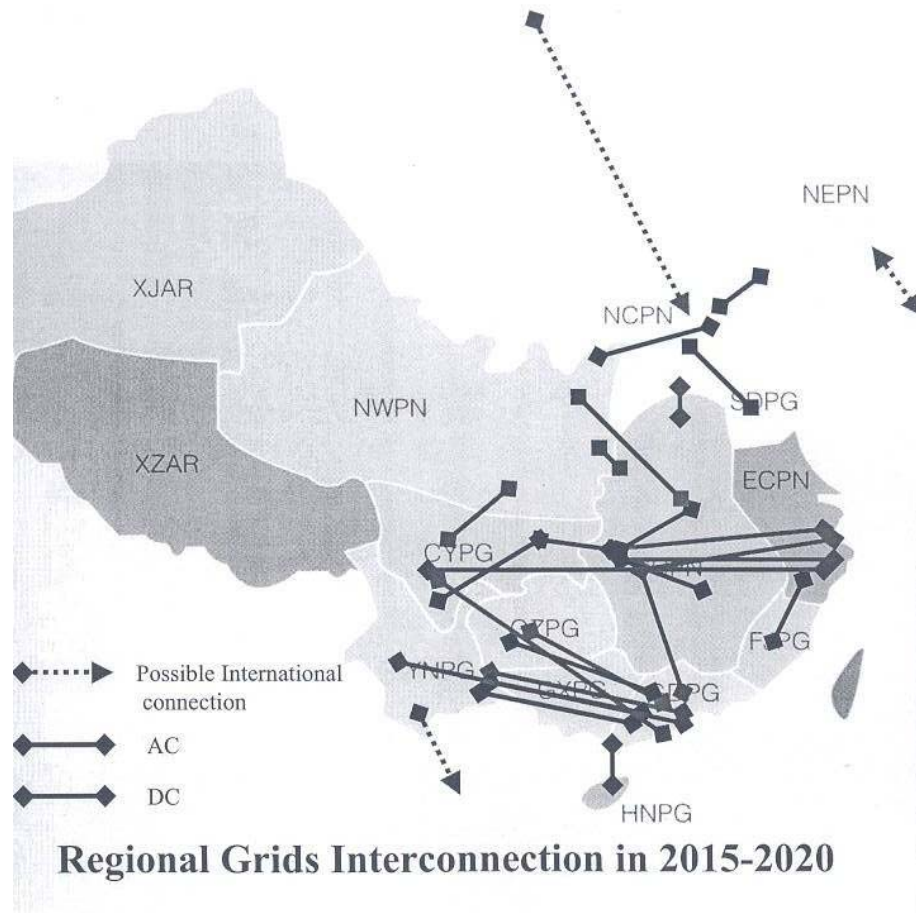


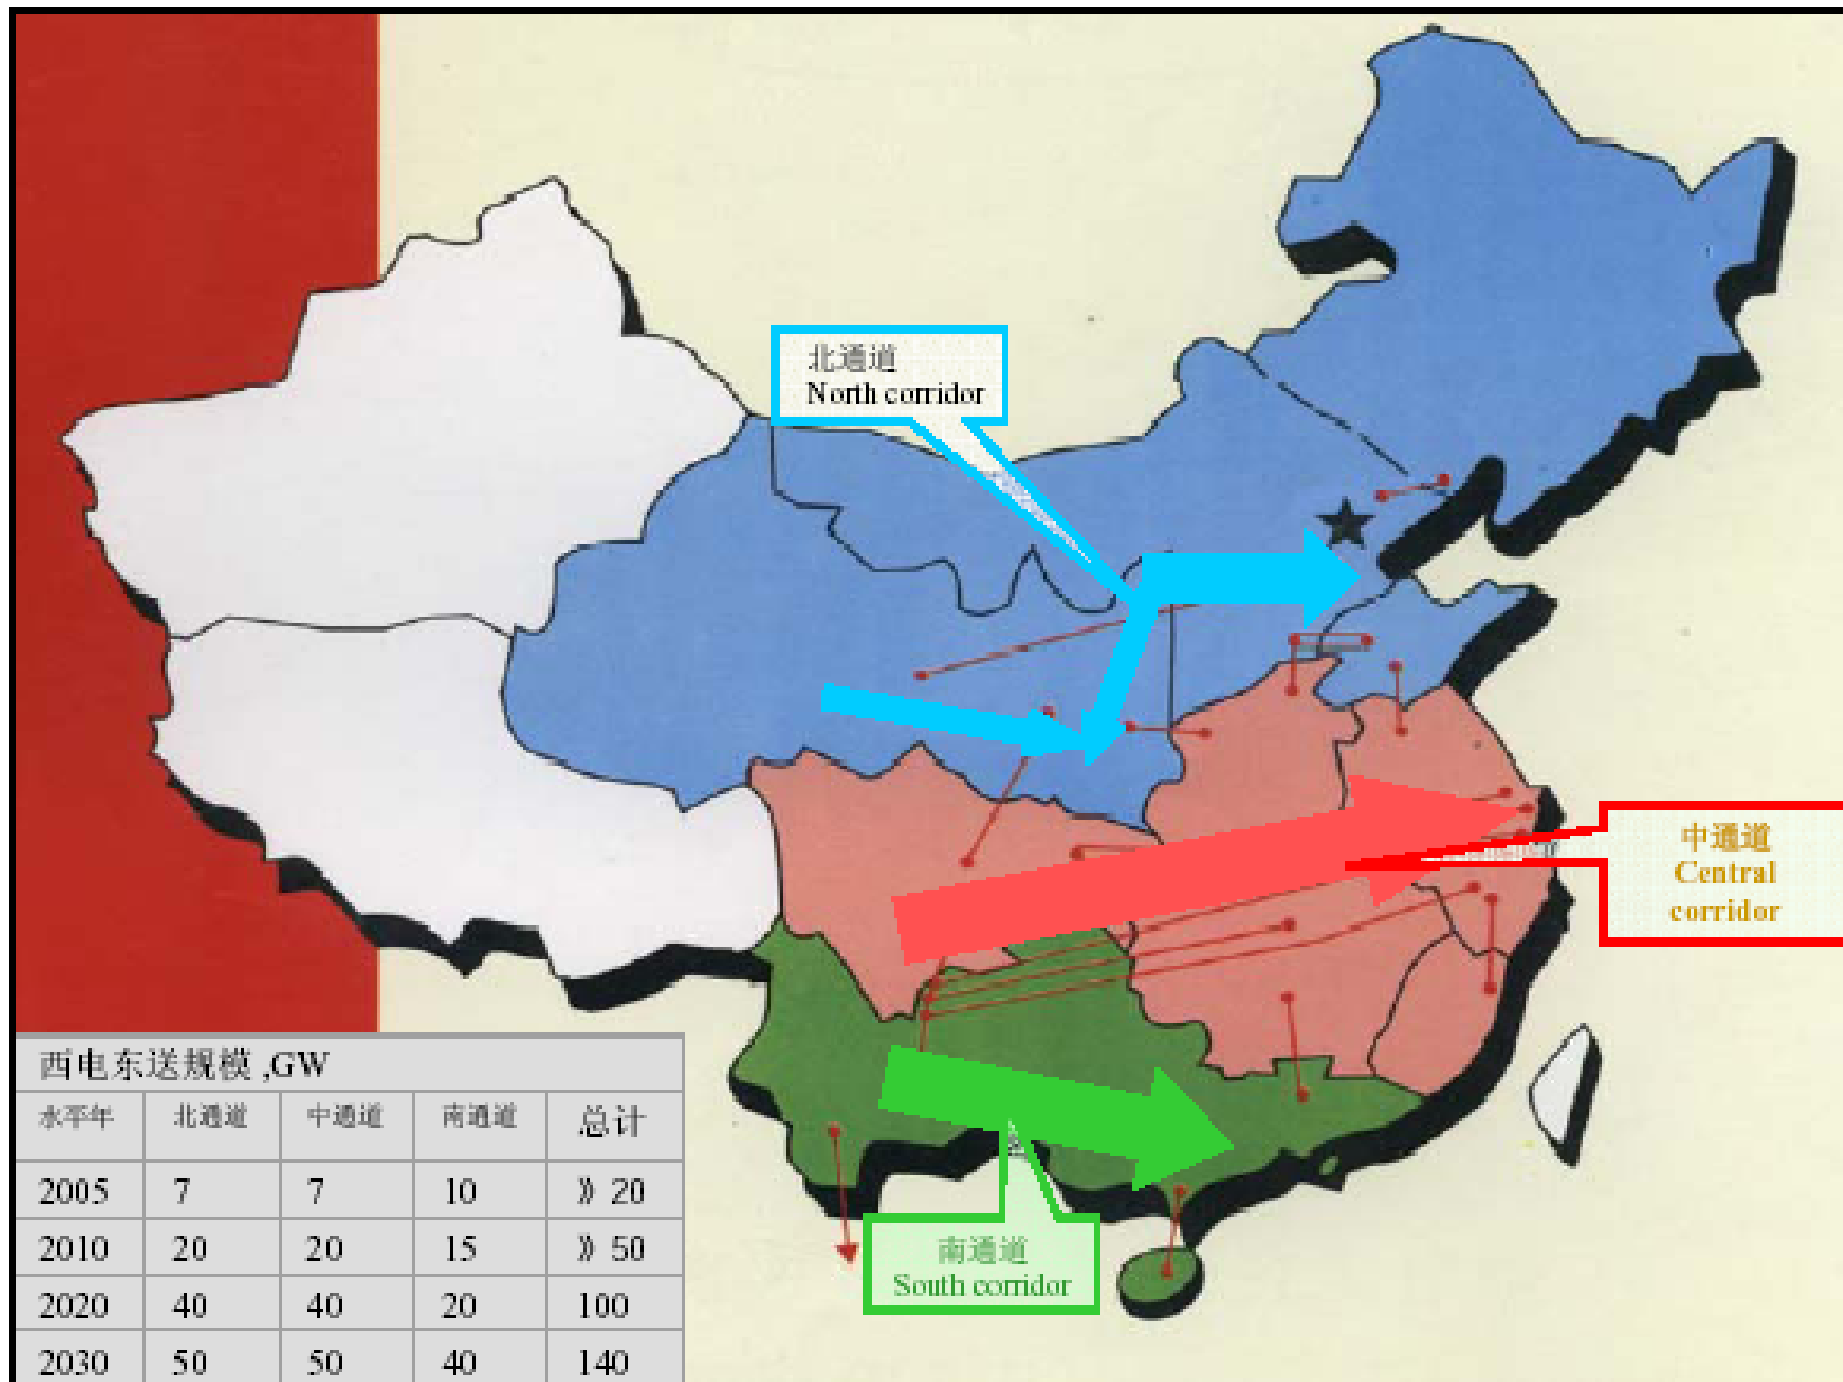

北通道
North corridor

中通道
Central
corridor

南通道
South corridor

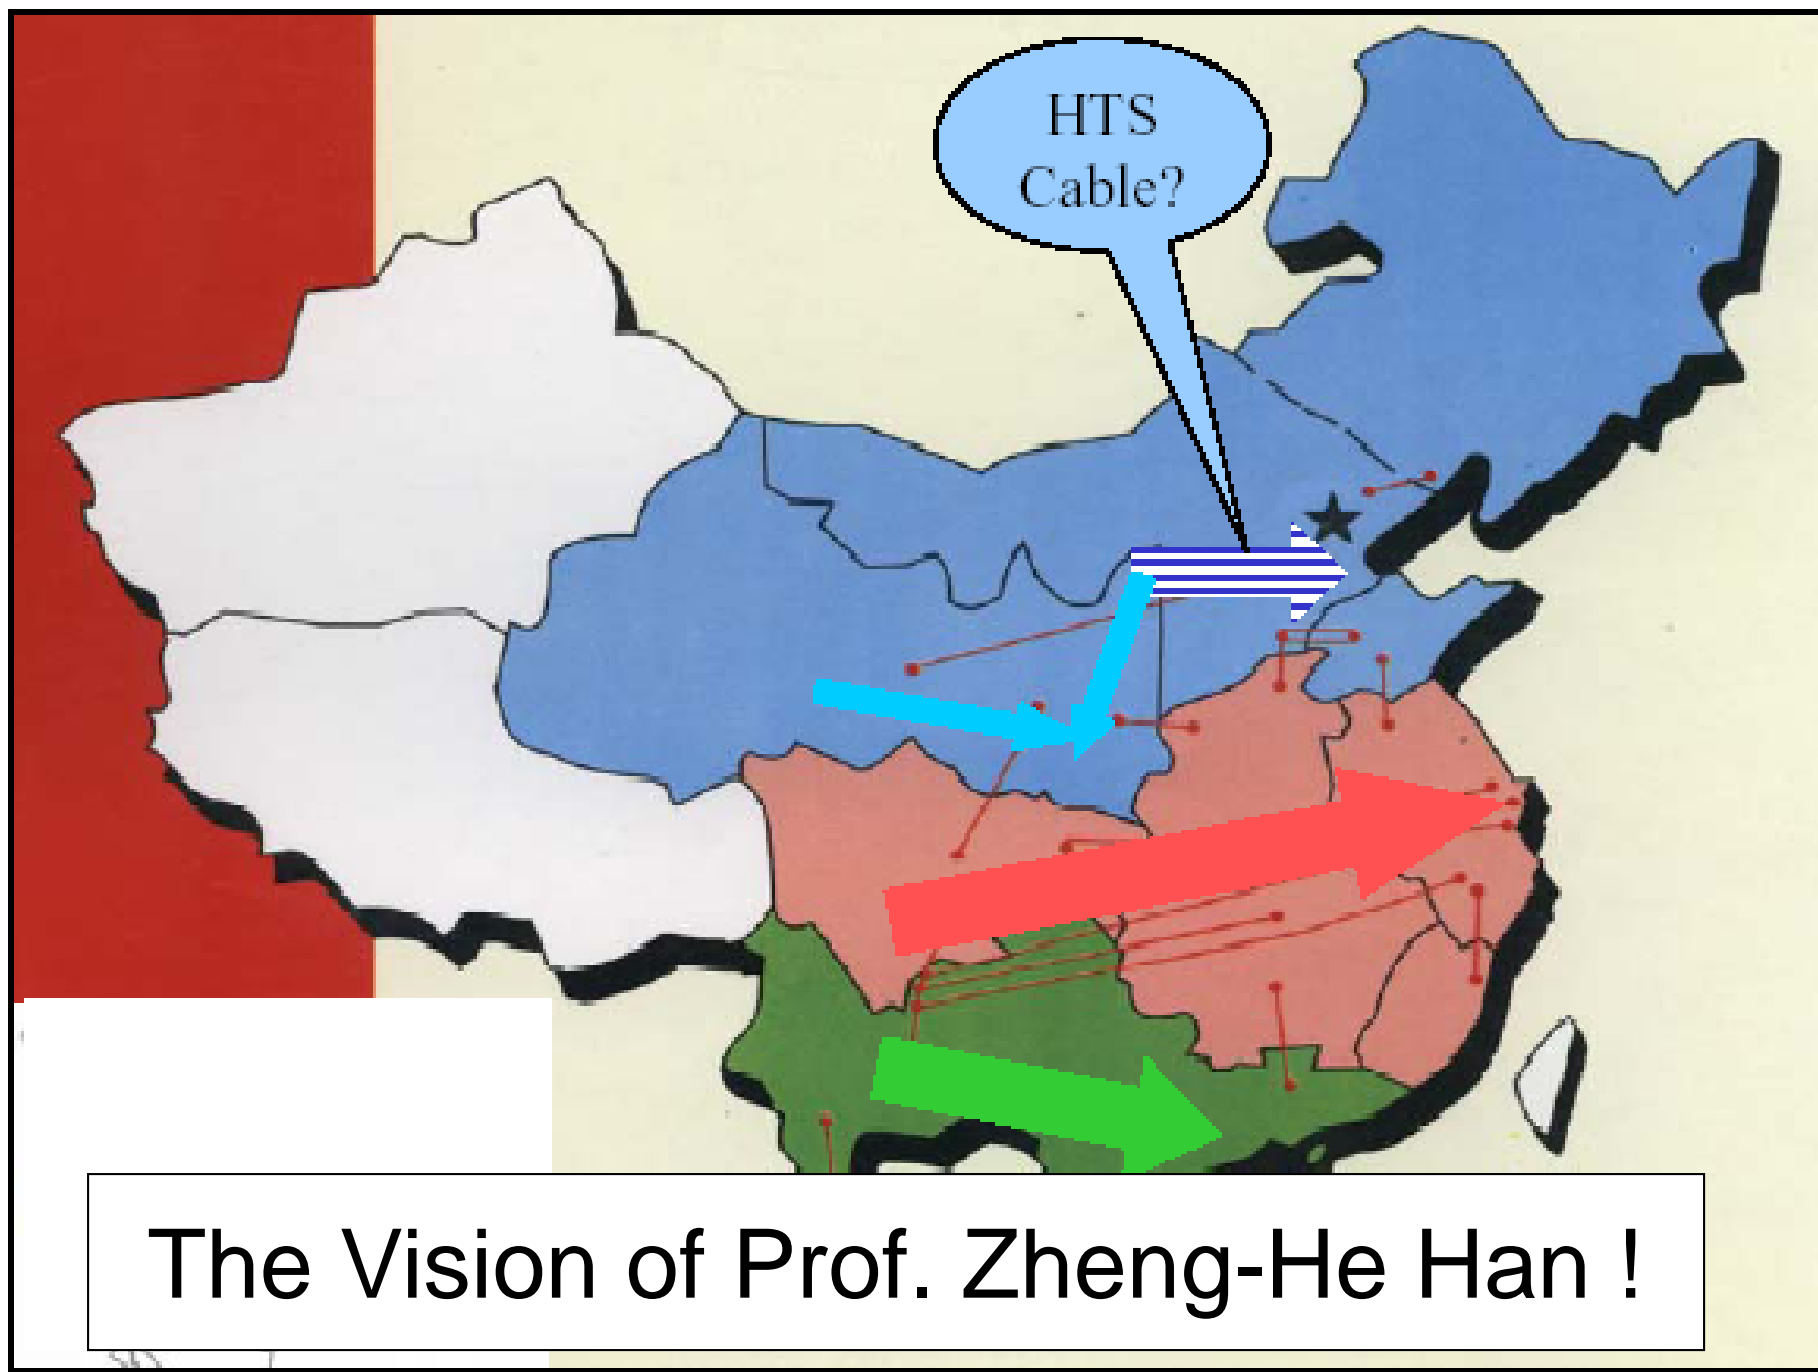

The Vision of Prof. Zheng-He Han !

**Will China Build the
World's First SuperGrid?**